
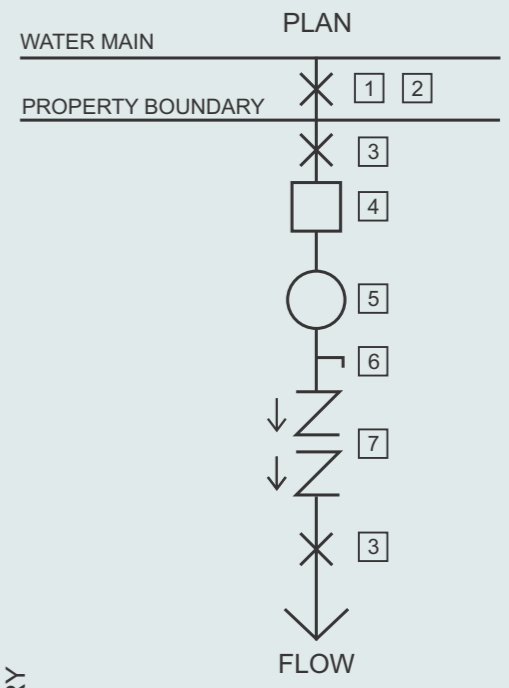


**TESTING FERRULES ARE NOT TO BE USED AS A WATER SUPPLY POINT - TEMPORARY OR PERMANENT**

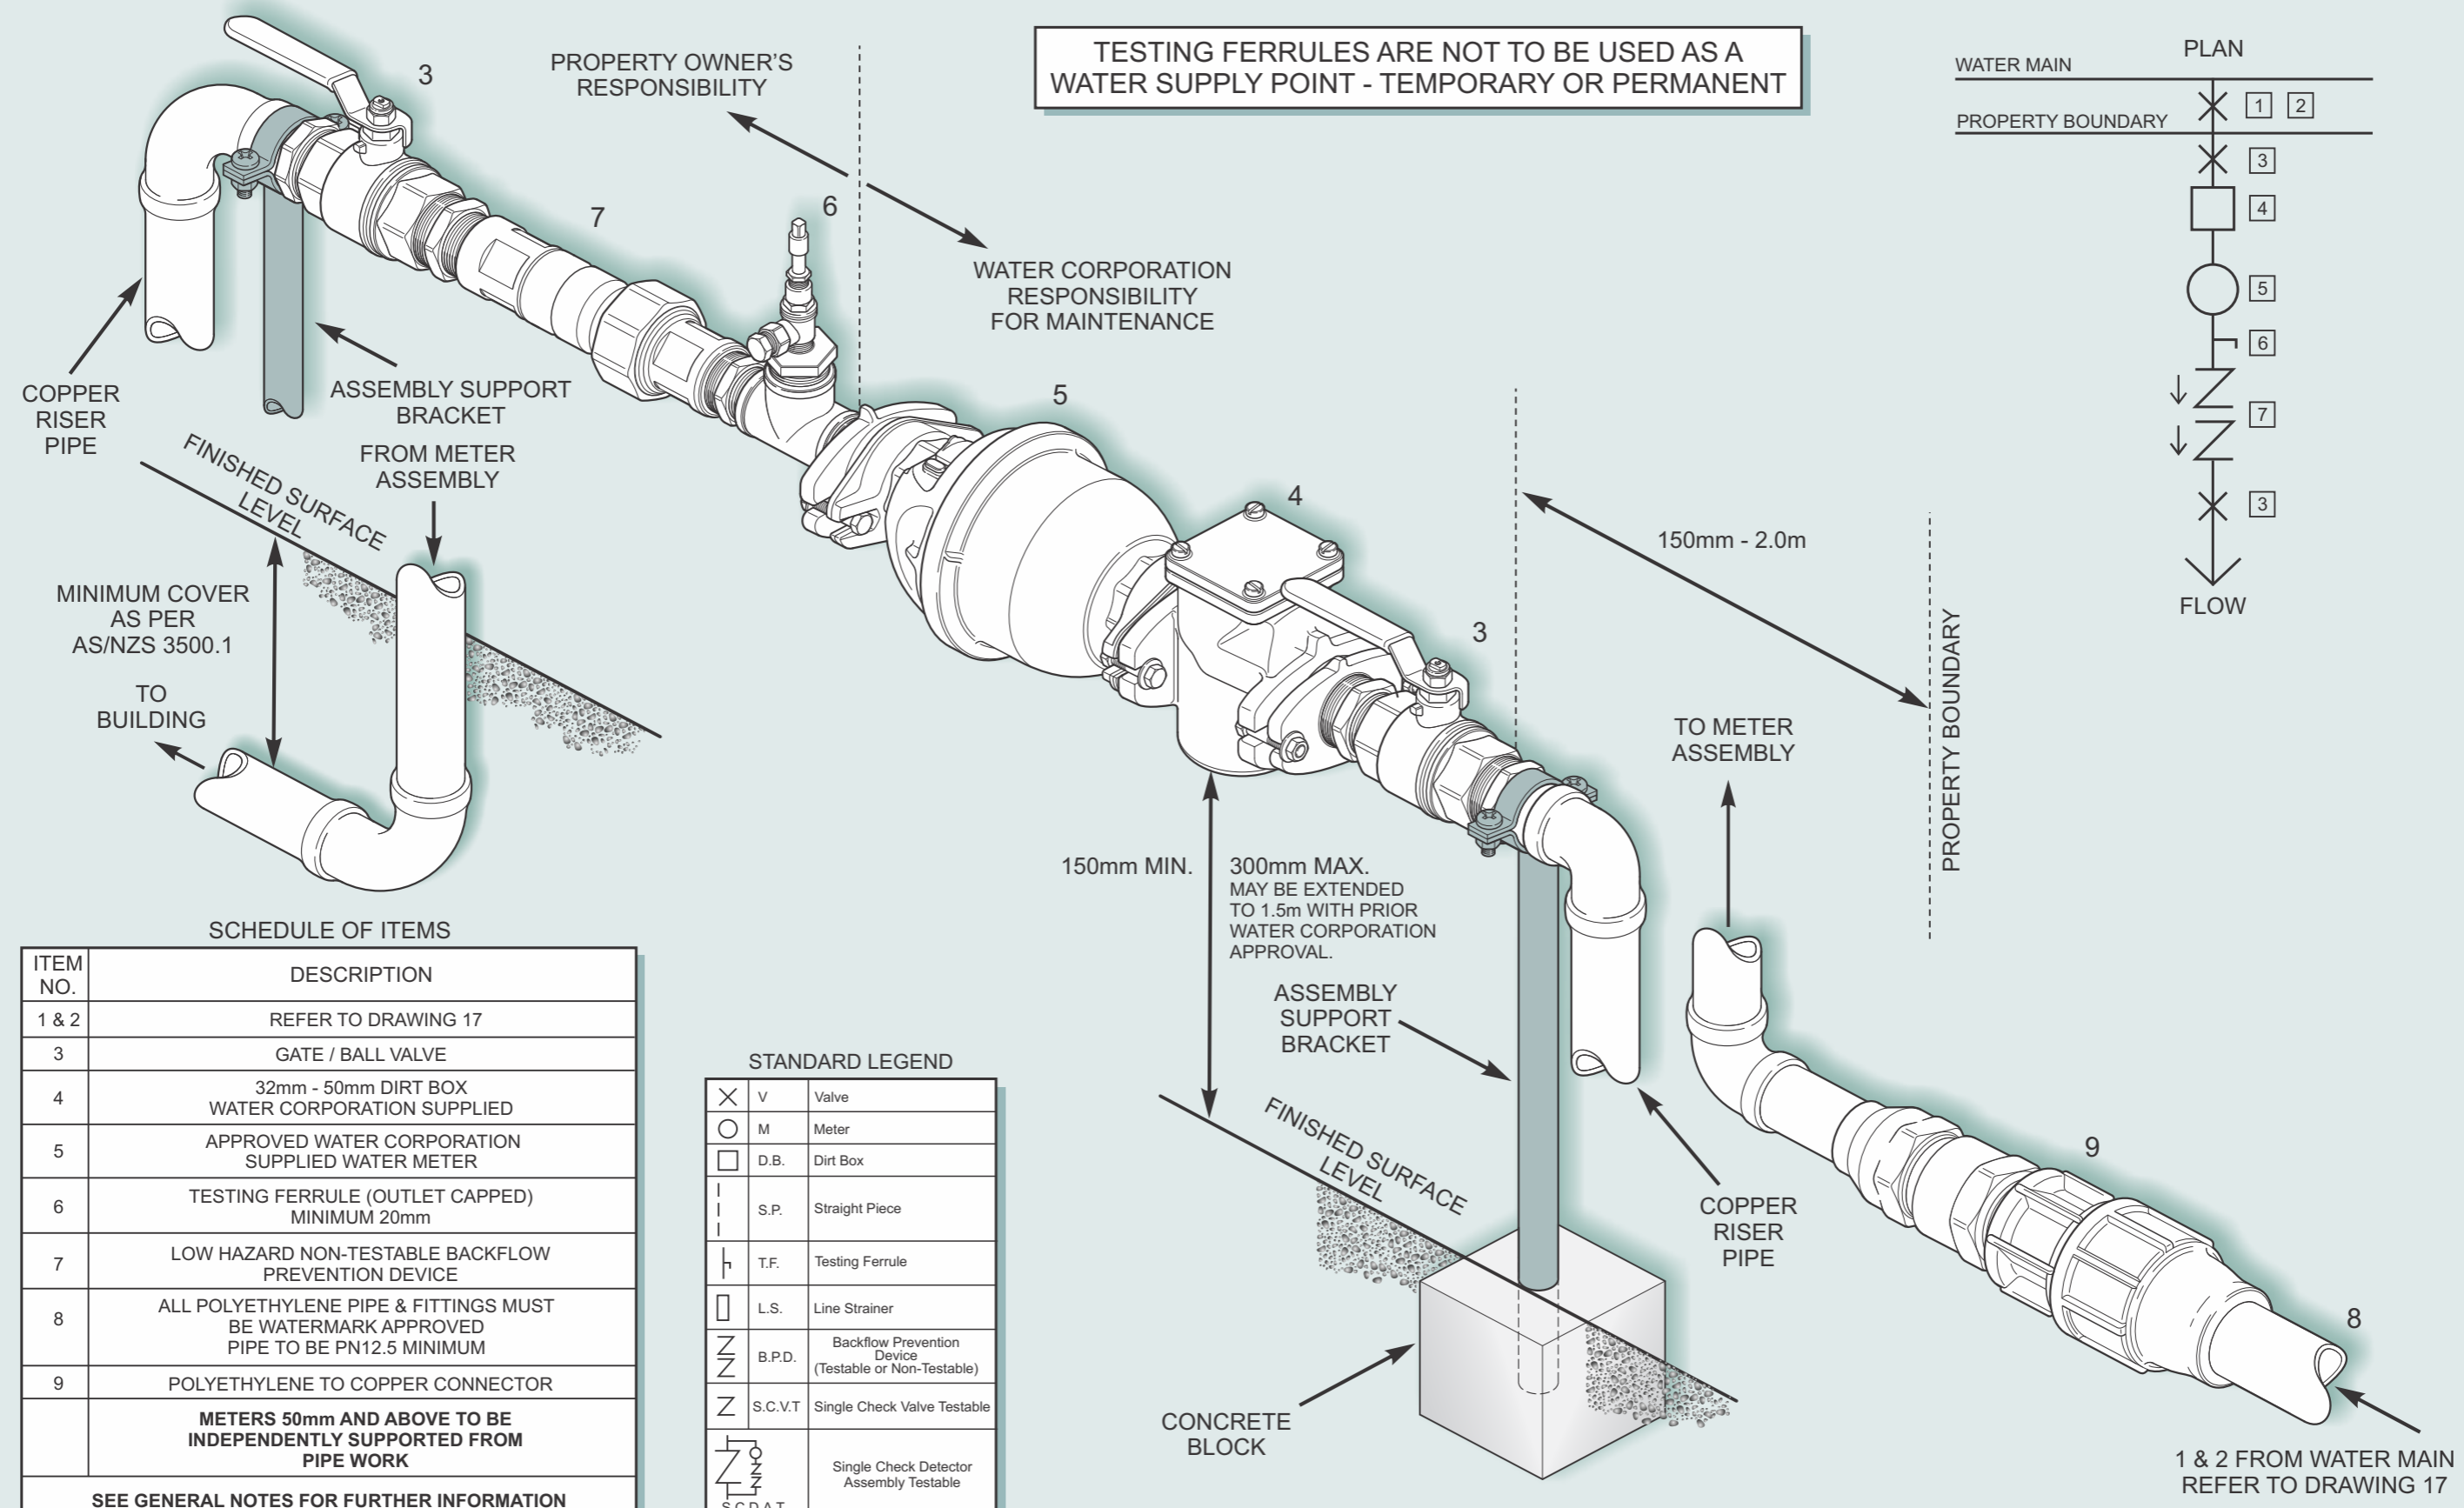

**SCHEDULE OF ITEMS**

ITEM NO.	DESCRIPTION
1 & 2	REFER TO DRAWING 17
3	GATE / BALL VALVE
4	32mm - 50mm DIRT BOX WATER CORPORATION SUPPLIED
5	APPROVED WATER CORPORATION SUPPLIED WATER METER
6	TESTING FERRULE (OUTLET CAPPED) MINIMUM 20mm
7	LOW HAZARD NON-TESTABLE BACKFLOW PREVENTION DEVICE
8	ALL POLYETHYLENE PIPE & FITTINGS MUST BE WATERMARK APPROVED PIPE TO BE PN12.5 MINIMUM
9	POLYETHYLENE TO COPPER CONNECTOR
<b>METERS 50mm AND ABOVE TO BE INDEPENDENTLY SUPPORTED FROM PIPE WORK</b>	
<b>SEE GENERAL NOTES FOR FURTHER INFORMATION</b>	

**STANDARD LEGEND**

⊗	V	Valve
○	M	Meter
□	D.B.	Dirt Box
—	S.P.	Straight Piece
⊥	T.F.	Testing Ferrule
▭	L.S.	Line Strainer
⌌	B.P.D.	Backflow Prevention Device (Testable or Non-Testable)
⌌	S.C.V.T	Single Check Valve Testable
⌌	S.C.D.A.T.	Single Check Detector Assembly Testable