


STANDARDS (ABOVE GROUND FOI)

- 1 A TRADE WASTE APPLICATION MUST BE SUBMITTED BEFORE WORK COMMENCES
- 2 THE FOI SHALL HAVE A MINIMUM WATER CAPACITY AS SPECIFIED BY THE WATER AUTHORITY'S SIZING CRITERIA
- 3 THE RELEVANT COUNCIL HEALTH DEPARTMENT MAY HAVE CONDITIONS RELATING TO THE LOCATION OF THE FOI
- 4 INSTALLATION TO BE IN ACCORDANCE WITH THE RELEVANT PLUMBING REGULATIONS
- 5 THE FOI MUST BE INSTALLED BY A LICENSED PLUMBER AND A CERTIFICATE OF COMPLIANCE ISSUED BY THE PLUMBER
- 6 EASE OF ACCESS FOR INSPECTIONS AND MAINTENANCE IS REQUIRED. THE ENTIRE INTERNAL CHAMBER MUST BE EASILY ACCESSIBLE AT ALL TIMES.
- 7 THE FOI SHALL NOT BE INSTALLED IN A CONFINED SPACE AS DEFINED BY THE WORKSAFE CODE OF VICTORIA
- 8 THE INSTALLATION OF REMOTE SUCTION LINES MUST BE IN ACCORDANCE WITH THE WATER AUTHORITY'S GUIDELINES
- 9 UNDERSIZED FOIS MAY NOT BE ACCEPTED
- 10 ALL TRADE WASTE GENERATING FIXTURES AS TABLED IN THE WATER AUTHORITY'S SIZING CRITERIA MUST BE CONNECTED TO THE FOI
- 11 ALL FOIS INSTALLED MUST COMPLY WITH THIS STANDARD DRAWING OR AS OTHERWISE VARIED BY THE EXPRESS PERMISSION OF THE WATER AUTHORITY
- 12 NO ALTERNATE APPARATUS WILL BE ACCEPTED WITHOUT THE CONSENT OF THE WATER AUTHORITY
- 13 SUPPORT PLATFORMS, LADDERS AND HANDRAILS MUST BE INSTALLED IN ACCORDANCE WITH RELEVANT STANDARD - FIXED PLATFORMS, WALKWAYS, STAIRWAYS AND LADDERS (AS1657)

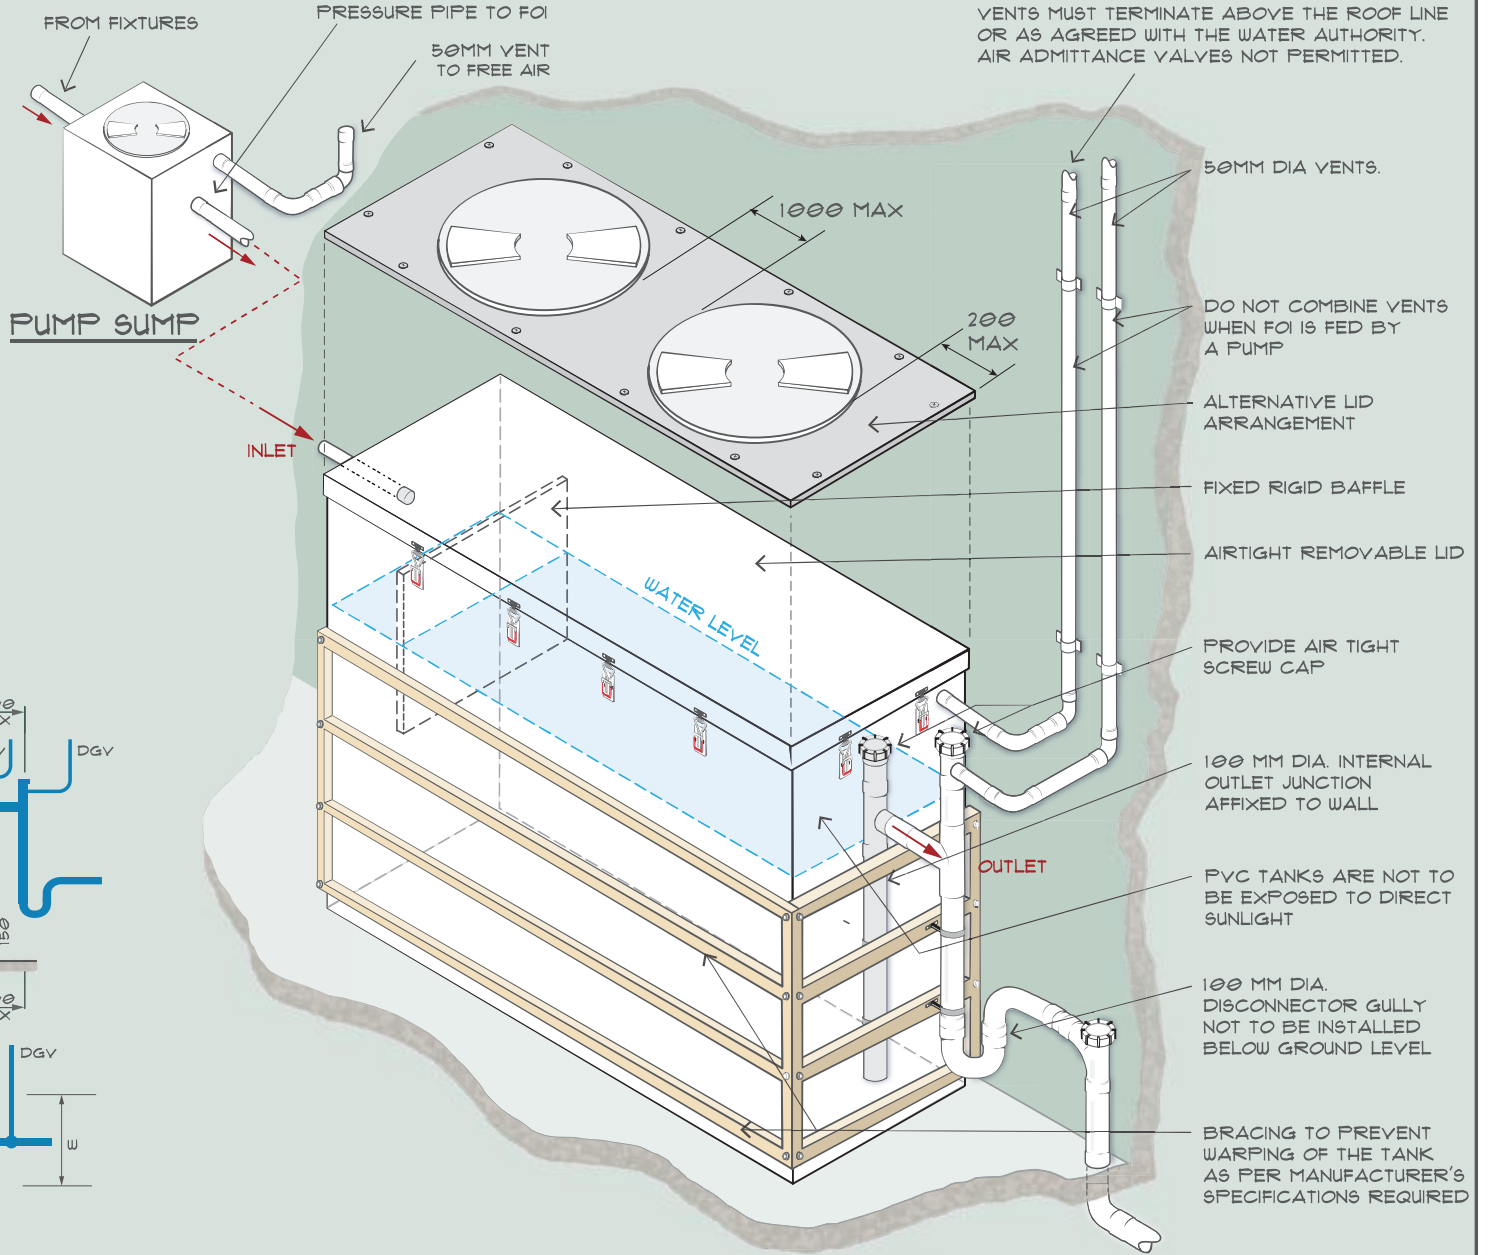

SECTION

PLAN

KEY DIMENSIONS

DRAWING NO:

AM 15

REVISION

2

SCALE

NTS

DATE

DEC 2016

FOOD AND OIL INTERCEPTOR ABOVE GROUND INSTALLATION

