


SCHEDULE OF ITEMS

ITEM NO.	DESCRIPTION	ITEM NO.	DESCRIPTION
1	20mm TAPPING BAND / PRE-TAPPED CONNECTOR	8	BACKFLOW PREVENTION DEVICE (LOW HAZARD NON-TESTABLE) YARRA VALLEY WATER USE DUAL CHECK WATER METER IN PLACE OF A DUAL CHECK VALVE
2	20mm BALL VALVE	9	ELBOW
3	ALL POLYETHYLENE PIPE & FITTINGS MUST BE WATERMARK APPROVED PIPE TO BE PN12.5 MINIMUM	10	TIMBER STAKE
4	POLYETHYLENE TO COPPER CONNECTOR	11	HOSE BIB TAP NOT SUPPLIED BY YARRA VALLEY WATER
5	DEPTH - MINIMUM COVER AUST. STANDARD AS/NZS 3500.1 AND LOCAL COUNCIL REQUIREMENTS	12	HOSE CONNECTION VACUUM BREAKER
6	20mm RIGHT ANGLE BALL VALVE	13	TUBE BUSH
7	20mm APPROVED WATER CORPORATION SUPPLIED WATER METER	14	BRASS PLUG
			SEE GENERAL NOTES FOR FURTHER INFORMATION

STANDARD LEGEND

⊗	V	Valve
○	M	Meter
□	D.B.	Dirt Box
	S.P.	Straight Piece
┌└	T.F.	Testing Ferrule
▭	L.S.	Line Strainer
∩	B.P.D.	Backflow Prevention Device (Testable or Non-Testable)
∩	S.C.V.T	Single Check Valve Testable
∩	S.C.D.A.T.	Single Check Detector Assembly Testable

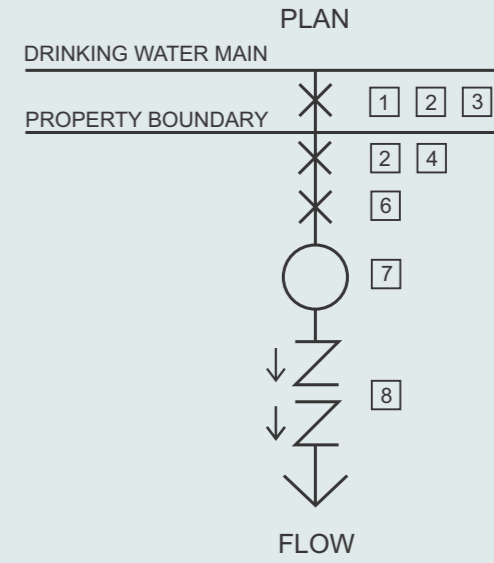

DRAWING NUMBER:

1A

SCALE:

NOT TO SCALE

DATE:

JULY 2017

20mm DRINKING WATER (DRY TAPPING)
LOW HAZARD
RESIDENTIAL INSTALLED BY RELEVANT WATER CORPORATION
TYPICAL ARRANGEMENT

