


WATER METERS LARGER THAN 25mm WILL REQUIRE A SEPARATE BACKFLOW PREVENTION DEVICE TO BE INSTALLED IMMEDIATELY DOWNSTREAM OF THE METER

STANDARD LEGEND

⊗	V	Valve
○	M	Meter
□	D.B.	Dirt Box
	S.P.	Straight Piece
┌┐	T.F.	Testing Ferrule
┌┐	L.S.	Line Strainer
⌌	B.P.D.	Backflow Prevention Device (Testable or Non-Testable)
⌌	S.C.V.T.	Single Check Valve Testable
⌌	S.C.D.A.T.	Single Check Detector Assembly Testable

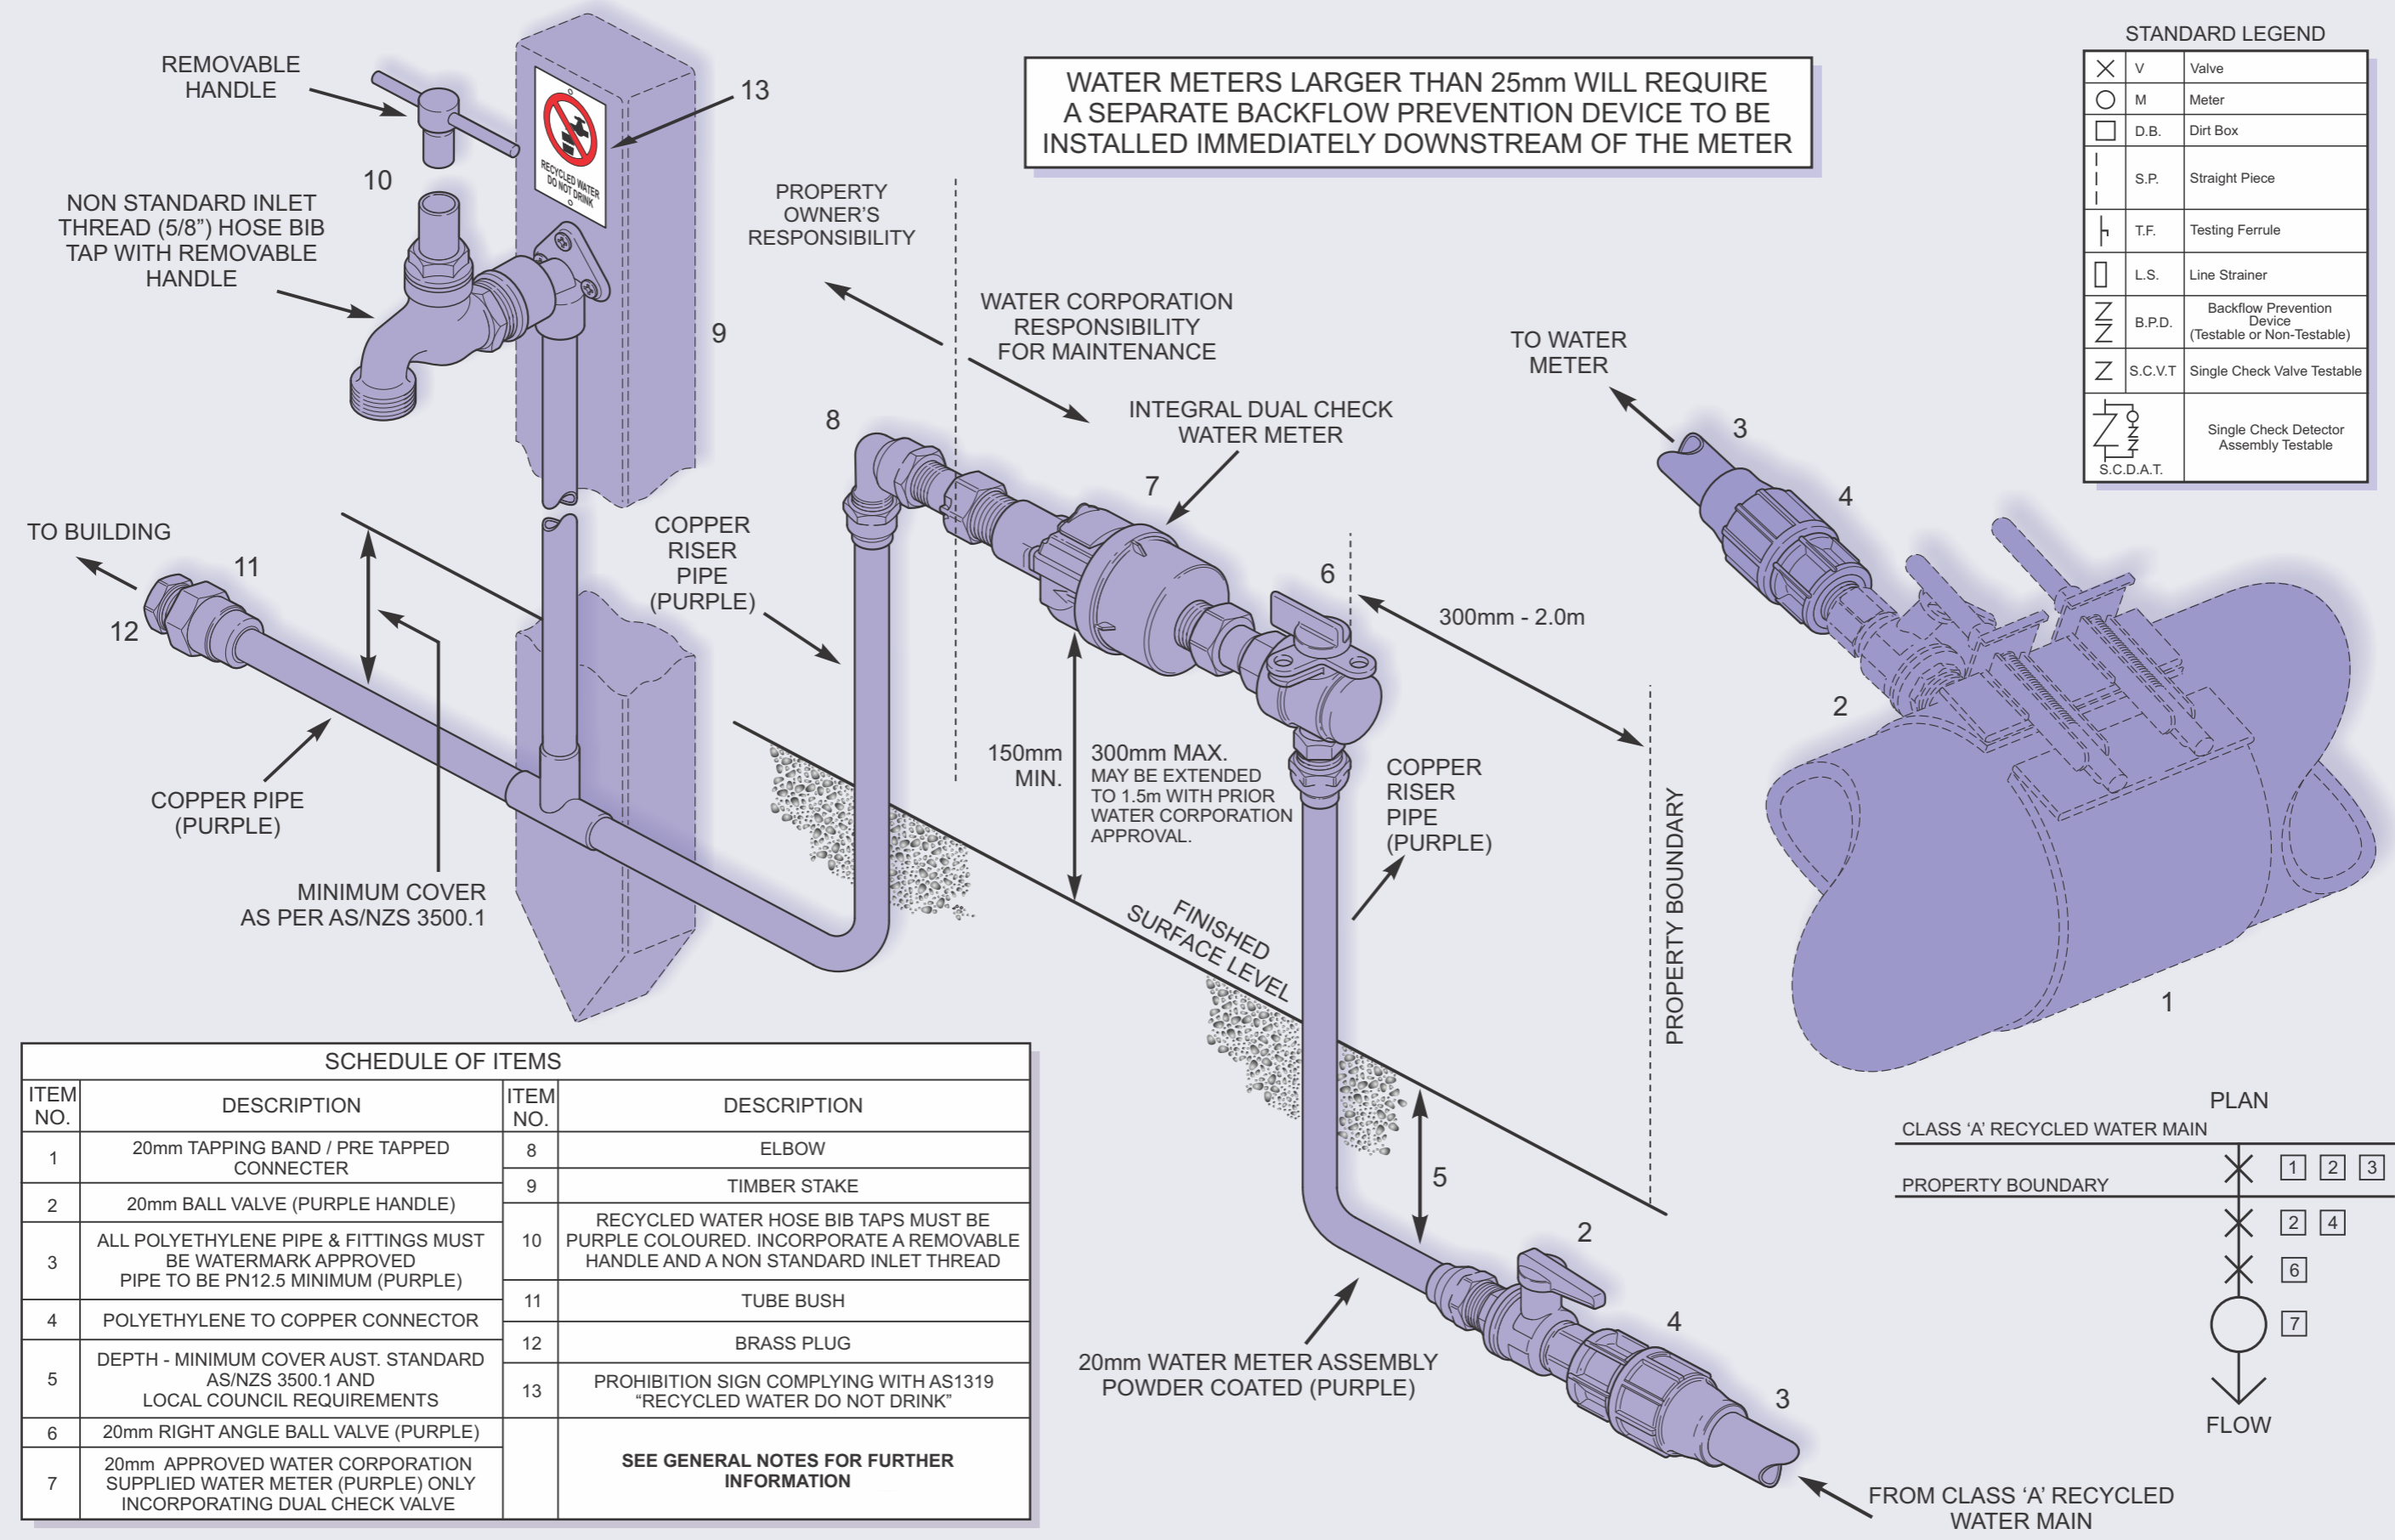

SCHEDULE OF ITEMS

ITEM NO.	DESCRIPTION	ITEM NO.	DESCRIPTION
1	20mm TAPPING BAND / PRE TAPPED CONNECTOR	8	ELBOW
2	20mm BALL VALVE (PURPLE HANDLE)	9	TIMBER STAKE
3	ALL POLYETHYLENE PIPE & FITTINGS MUST BE WATERMARK APPROVED PIPE TO BE PN12.5 MINIMUM (PURPLE)	10	RECYCLED WATER HOSE BIB TAPS MUST BE PURPLE COLOURED. INCORPORATE A REMOVABLE HANDLE AND A NON STANDARD INLET THREAD
4	POLYETHYLENE TO COPPER CONNECTOR	11	TUBE BUSH
5	DEPTH - MINIMUM COVER AUST. STANDARD AS/NZS 3500.1 AND LOCAL COUNCIL REQUIREMENTS	12	BRASS PLUG
6	20mm RIGHT ANGLE BALL VALVE (PURPLE)	13	PROHIBITION SIGN COMPLYING WITH AS1319 "RECYCLED WATER DO NOT DRINK"
7	20mm APPROVED WATER CORPORATION SUPPLIED WATER METER (PURPLE) ONLY INCORPORATING DUAL CHECK VALVE		SEE GENERAL NOTES FOR FURTHER INFORMATION

DRAWING NUMBER:
1B

SCALE:
NOT TO SCALE

DATE:
JULY 2017

20mm RECYCLED WATER RESIDENTIAL (DRY TAPPING)
INSTALLED BY RELEVANT WATER CORPORATION
TYPICAL ARRANGEMENT

