


NOTE: Yarra Valley Water require a plugged 25mm BSP connection at this location. Greater Western Water and South East Water **do not** allow any connection, outlet or plugged fitting between the water meter and the backflow device

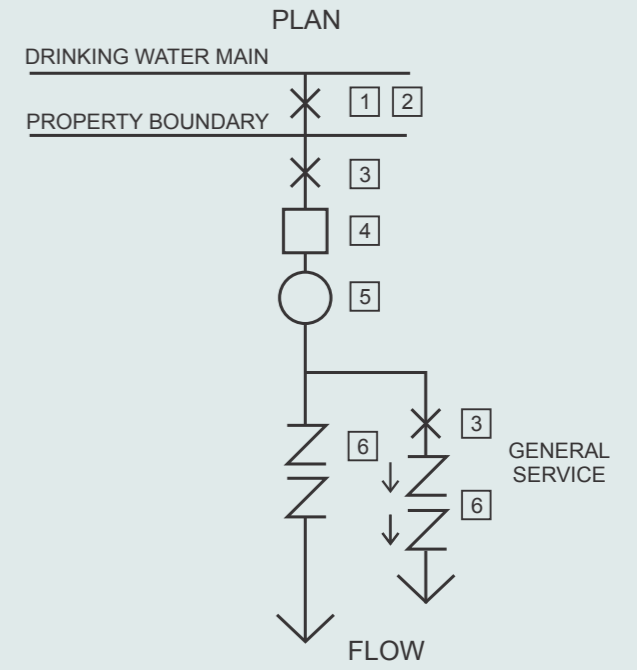

STANDARD LEGEND

V	Valve
M	Meter
□	D.B. Dirt Box
---	S.P. Straight Piece
□	L.S. Line Strainer
Z	B.P.D. Backflow Prevention Device (Testable or Non-Testable)
Z	S.C.V.T. Single Check Valve Testable
Z	S.C.D.A.T. Single Check Detector Assembly Testable

SCHEDULE OF ITEMS	
ITEM NO.	DESCRIPTION
1 & 2	REFER TO DRAWING 17
3	GATE / BALL VALVE
4	DIRT BOX FOR 32mm + WATER CORPORATION SUPPLIED
5	APPROVED WATER CORPORATION SUPPLIED WATER METER
6	APPROPRIATE APPROVED BACKFLOW PREVENTION DEVICE
SEE GENERAL NOTES FOR FURTHER INFORMATION	

GENERAL NOTES:

- A. METERS 50MM AND ABOVE TO BE SUPPORTED INDEPENDENT OF PIPEWORK
- B. NO CONNECTION PERMITTED BETWEEN WATER METER AND BACKFLOW DEVICE
- C. METER CONNECTION MAY BE SCREWED OR FLANGED
- D. WHERE FIRE SERVICES HAVE HOSE REELS IN AREAS SUBJECT TO POTENTIAL INTERCONNECTION WITH CONTAMINANTS, THE TYPE OF BACKFLOW PREVENTION DEVICES INSTALLED AT THE WATER METER MUST BE RELEVANT TO THE HAZARD RATING OF THE PROPERTY.