


The backflow devices shown are generic only. Please check the Notice of Agreement for specific backflow requirements. Where a testable device is required, isolation valves and strainers must be installed per AS/NZS3500.1

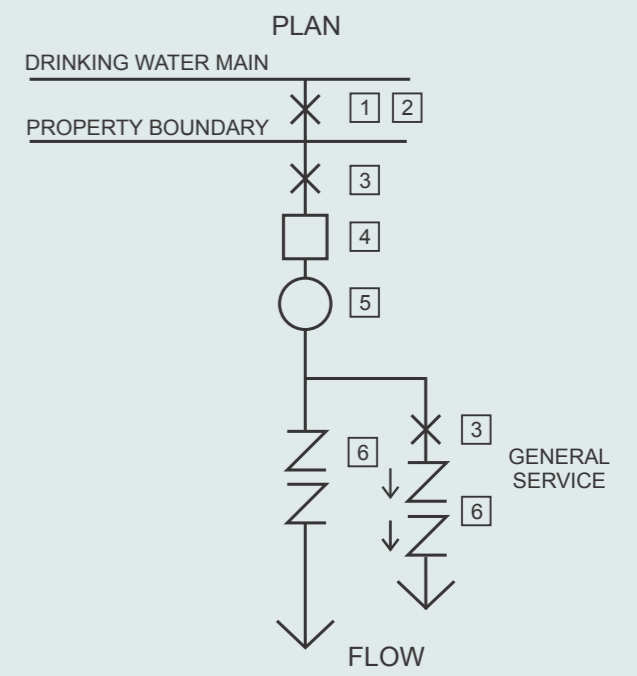

STANDARD LEGEND

V	Valve
M	Meter
□	D.B. Dirt Box
---	S.P. Straight Piece
□	L.S. Line Strainer
Z	B.P.D. Backflow Prevention Device (Testable or Non-Testable)
Z	S.C.V.T. Single Check Valve Testable
Z	S.C.D.A.T. Single Check Detector Assembly Testable

SCHEDULE OF ITEMS	
ITEM NO.	DESCRIPTION
1 & 2	REFER TO DRAWING 17
3	GATE / BALL VALVE
4	DIRT BOX FOR 32mm + WATER CORPORATION SUPPLIED
5	APPROVED WATER CORPORATION SUPPLIED WATER METER
6	APPROPRIATE APPROVED BACKFLOW PREVENTION DEVICE
SEE GENERAL NOTES FOR FURTHER INFORMATION	

GENERAL NOTES:

A. METERS 50MM AND ABOVE TO BE SUPPORTED INDEPENDENT OF PIPEWORK

B. NO CONNECTION PERMITTED BETWEEN WATER METER AND BACKFLOW DEVICE

C. METER CONNECTION MAY BE SCREWED OR FLANGED

D. WHERE FIRE SERVICES HAVE HOSE REELS IN AREAS SUBJECT TO POTENTIAL INTERCONNECTION WITH CONTAMINANTS, THE TYPE OF BACKFLOW PREVENTION DEVICES INSTALLED AT THE WATER METER MUST BE RELEVANT TO THE HAZARD RATING OF THE PROPERTY.