



SCHEDULE OF ITEMS	
ITEM NO.	DESCRIPTION
1 & 2	REFER TO DRAWING 17
3	ISOLATING VALVE. IF BUTTERFLY VALVE TO BE GEAR SHUT TYPE (RESILIENT SEATED)
4	SPACER 5 x PIPE DIAMETER
5	ELECTRO MAGNETIC FLOW WATER METER. SUPPLIED BY WATER CORPORATION. DIRT BOX NOT REQUIRED
6	SPACER 3 x PIPE DIAMETER
7	SINGLE CHECK VALVE TESTABLE
8	WATER METER FOR GENERAL SERVICE
9	APPROPRIATE BFD
METERS 50mm AND ABOVE TO BE INDEPENDENTLY SUPPORTED FROM PIPE WORK	
SEE GENERAL NOTES FOR FURTHER INFORMATION	

SPECIFIC CONSENT REQUIRED FROM RELEVANT FIRE AUTHORITY

ELECTRO MAGNETIC WATER METERS REQUIRE 240VOLT POWER SUPPLY WHERE SPECIFIED BY THE WATER CORPORATION

FEED HYDRANT TO BE LOCATED WITHIN 5 METRES OF BOOSTER ASSEMBLY BACKFLOW DEVICE

STANDARD LEGEND		
⊗	V	Valve
○	M	Meter
□	D.B.	Dirt Box
	S.P.	Straight Piece
⊥	T.F.	Testing Ferrule
□	L.S.	Line Strainer
⌌	B.P.D.	Backflow Prevention Device (Testable or Non-Testable)
⌌	S.C.V.T.	Single Check Valve Testable
⌌	S.C.D.A.T.	Single Check Detector Assembly Testable

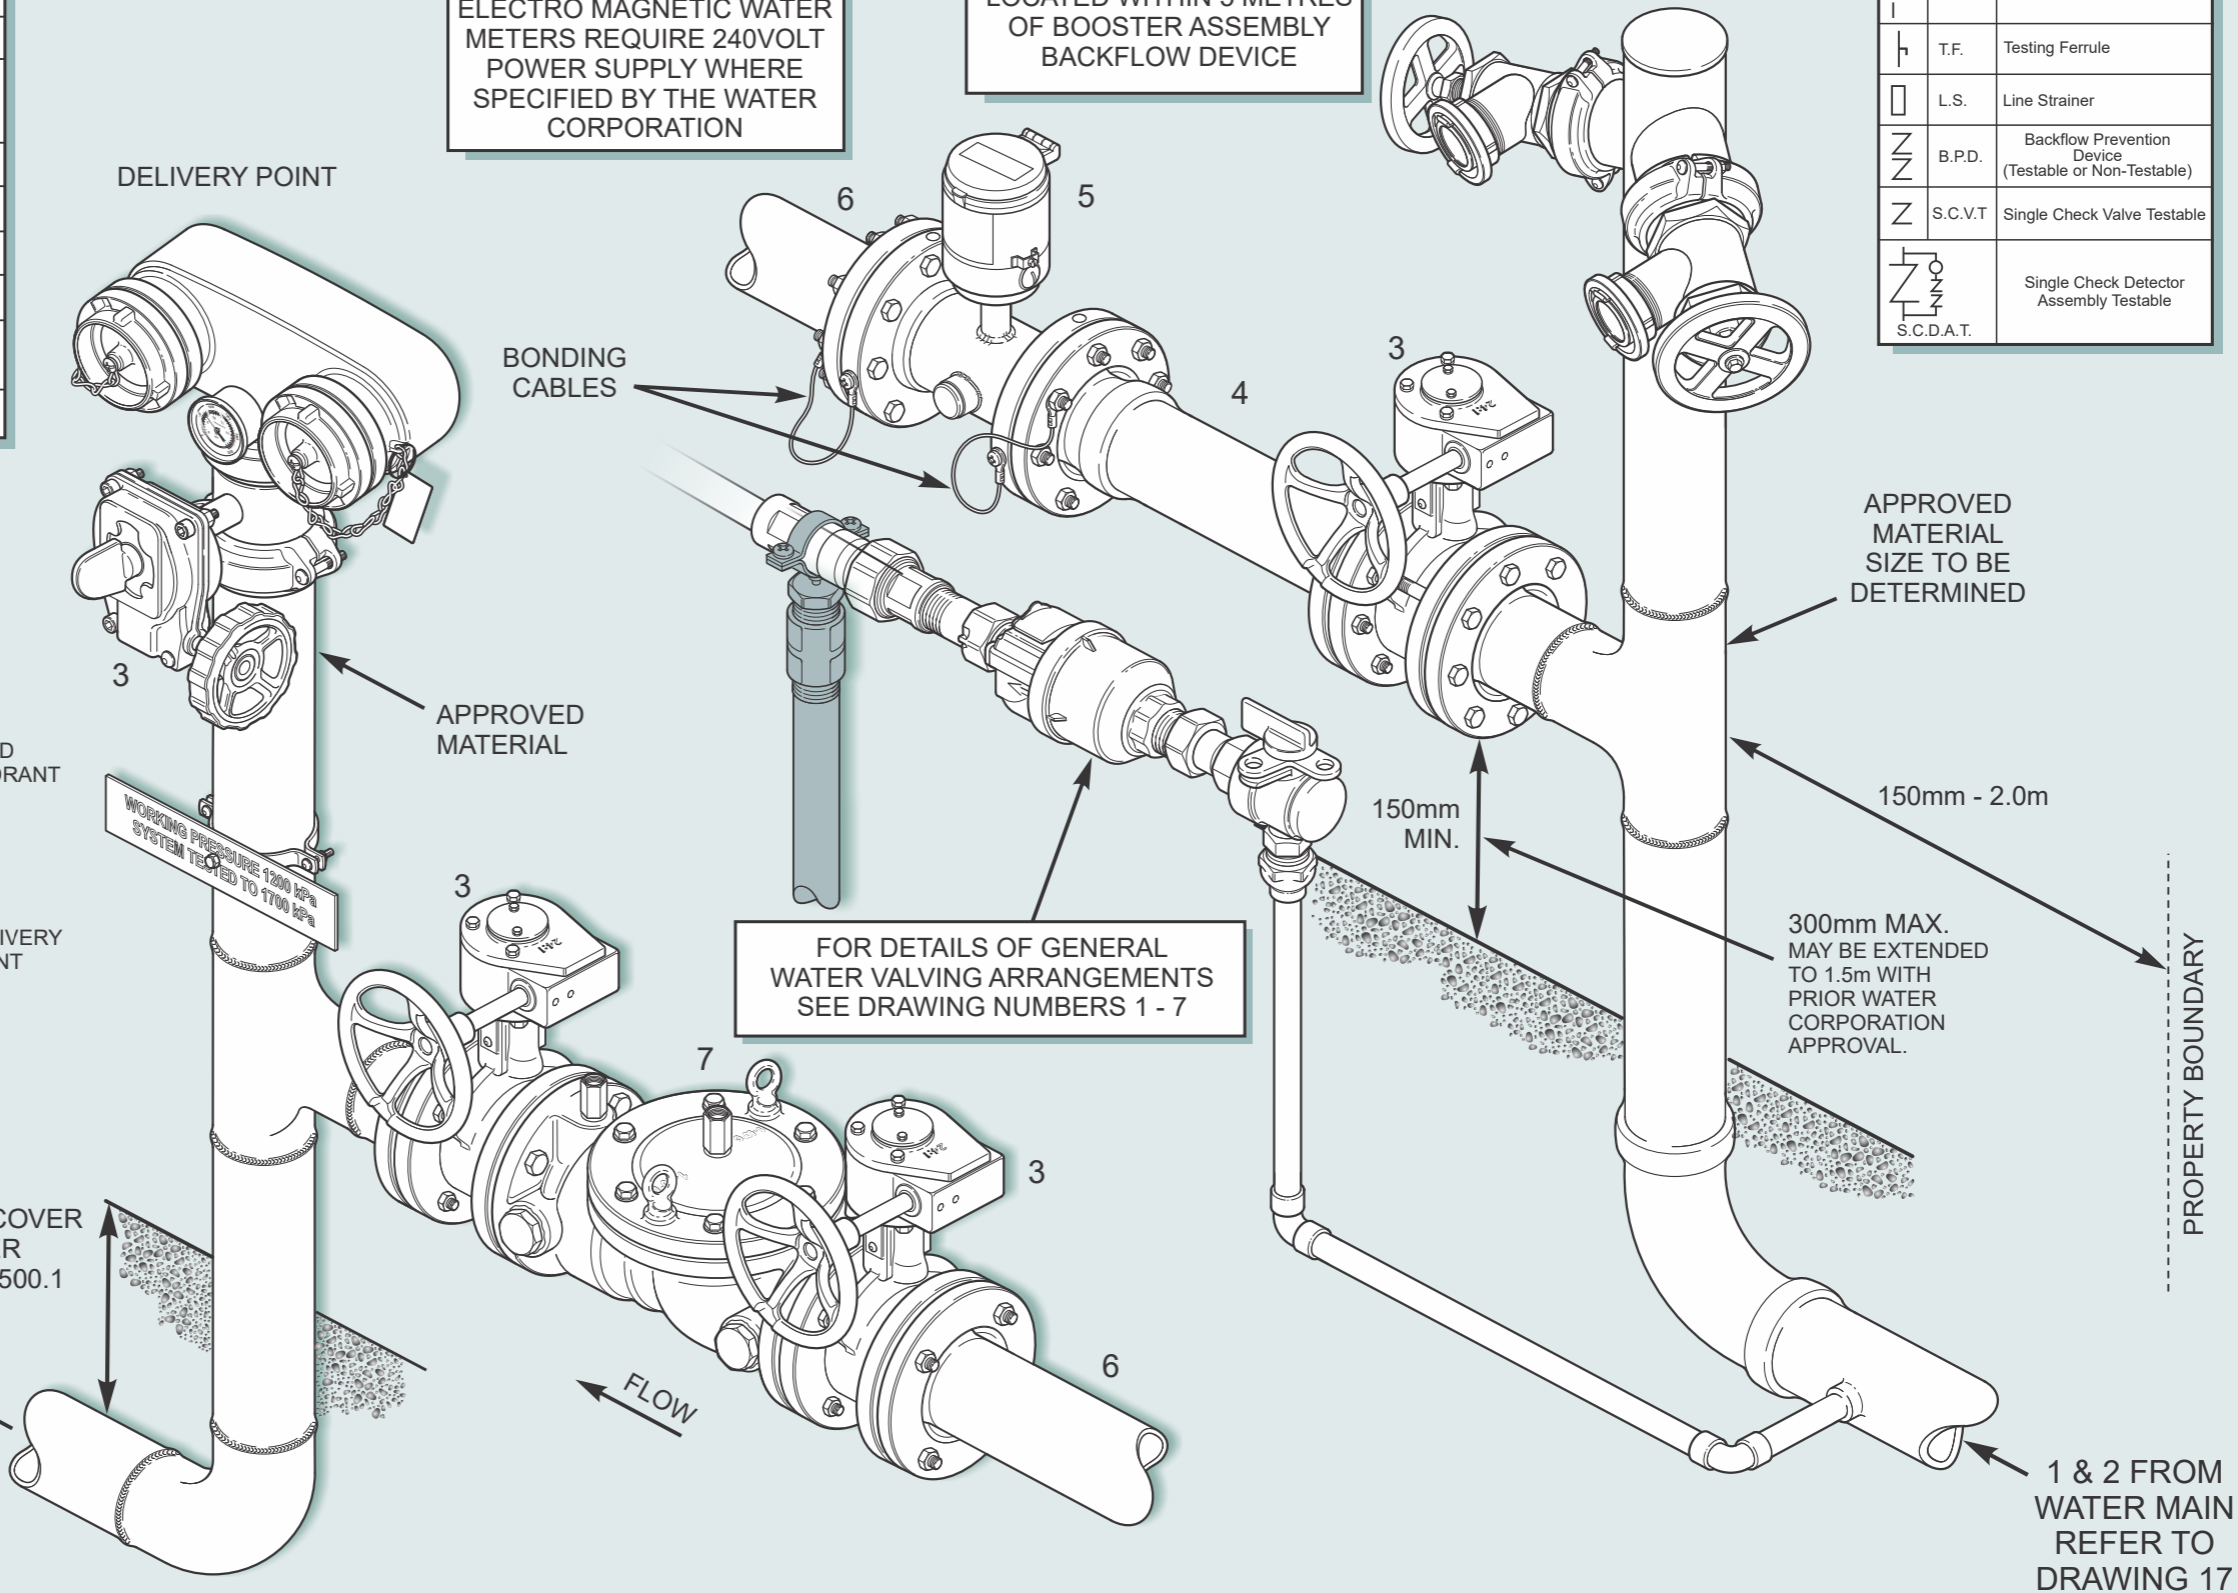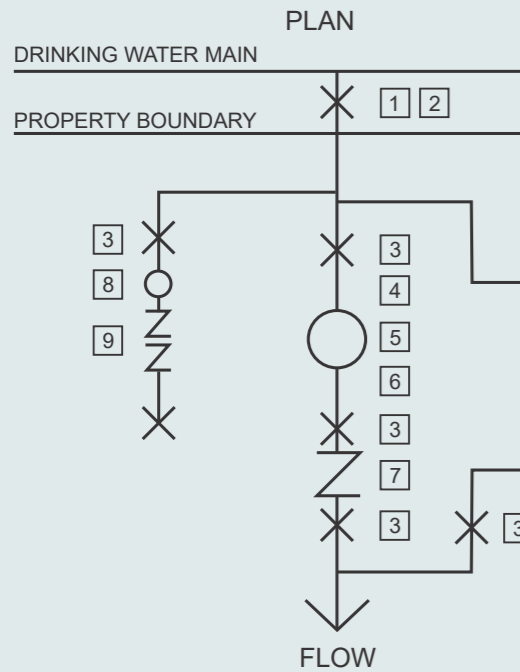

FOR DETAILS OF GENERAL WATER VALVING ARRANGEMENTS SEE DRAWING NUMBERS 1 - 7

DRAWING NUMBER:

13

SCALE:

NOT TO SCALE

DATE:

JULY 2017

BOOSTER CONNECTION AROUND METER
FIRE SPRINKLER SUPPLY
TYPICAL ARRANGEMENT

