


NOTE: Yarra Valley Water require a plugged 25mm BSP connection at this location. Greater Western Water and South East Water **do not** allow any connection, outlet or plugged fitting between the water meter and the backflow device

150mm MIN. 300mm MAX. MAY BE EXTENDED TO 1.5m WITH PRIOR WATER CORPORATION APPROVAL.

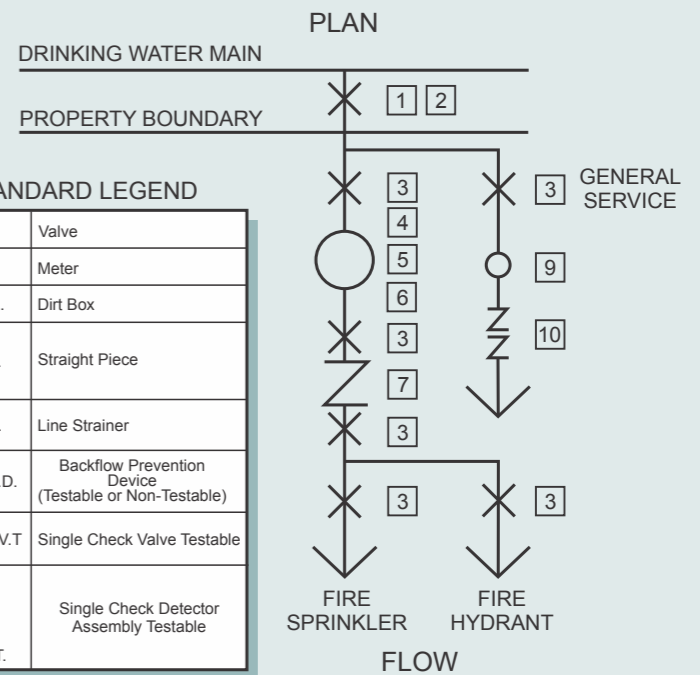

SCHEDULE OF ITEMS	
ITEM NO.	DESCRIPTION
1 & 2	REFER TO DRAWING 17
3	ISOLATING VALVE. IF BUTTERFLY VALVE TO BE GEAR SHUT TYPE (RESILIENT SEATED)
4	SPACER 5 x PIPE DIAMETER
5	MAGNETIC WATER METER. SUPPLIED BY WATER CORPORATION. DIRT BOX NOT REQUIRED
6	SPACER 3 x PIPE DIAMETER
7	SINGLE CHECK VALVE TESTABLE
8	WATER METER FOR GENERAL SERVICE
9	APPROPRIATE BFD
SEE GENERAL NOTES FOR FURTHER INFORMATION	

GENERAL NOTES:

A. METERS 50MM AND ABOVE TO BE SUPPORTED INDEPENDENT OF PIPEWORK

B. NO CONNECTION PERMITTED BETWEEN WATER METER AND BACKFLOW DEVICE

C. METER CONNECTION MAY BE SCREWED OR FLANGED

D. FOR DETAILS OF GENERAL WATER VALVING ARRANGEMENTS SEE DRAWING NUMBERS 1 – 7

E. ELECTRO MAGNETIC WATER METERS REQUIRE 240VOLT POWER SUPPLY WHERE SPECIFIED BY THE WATER CORPORATION