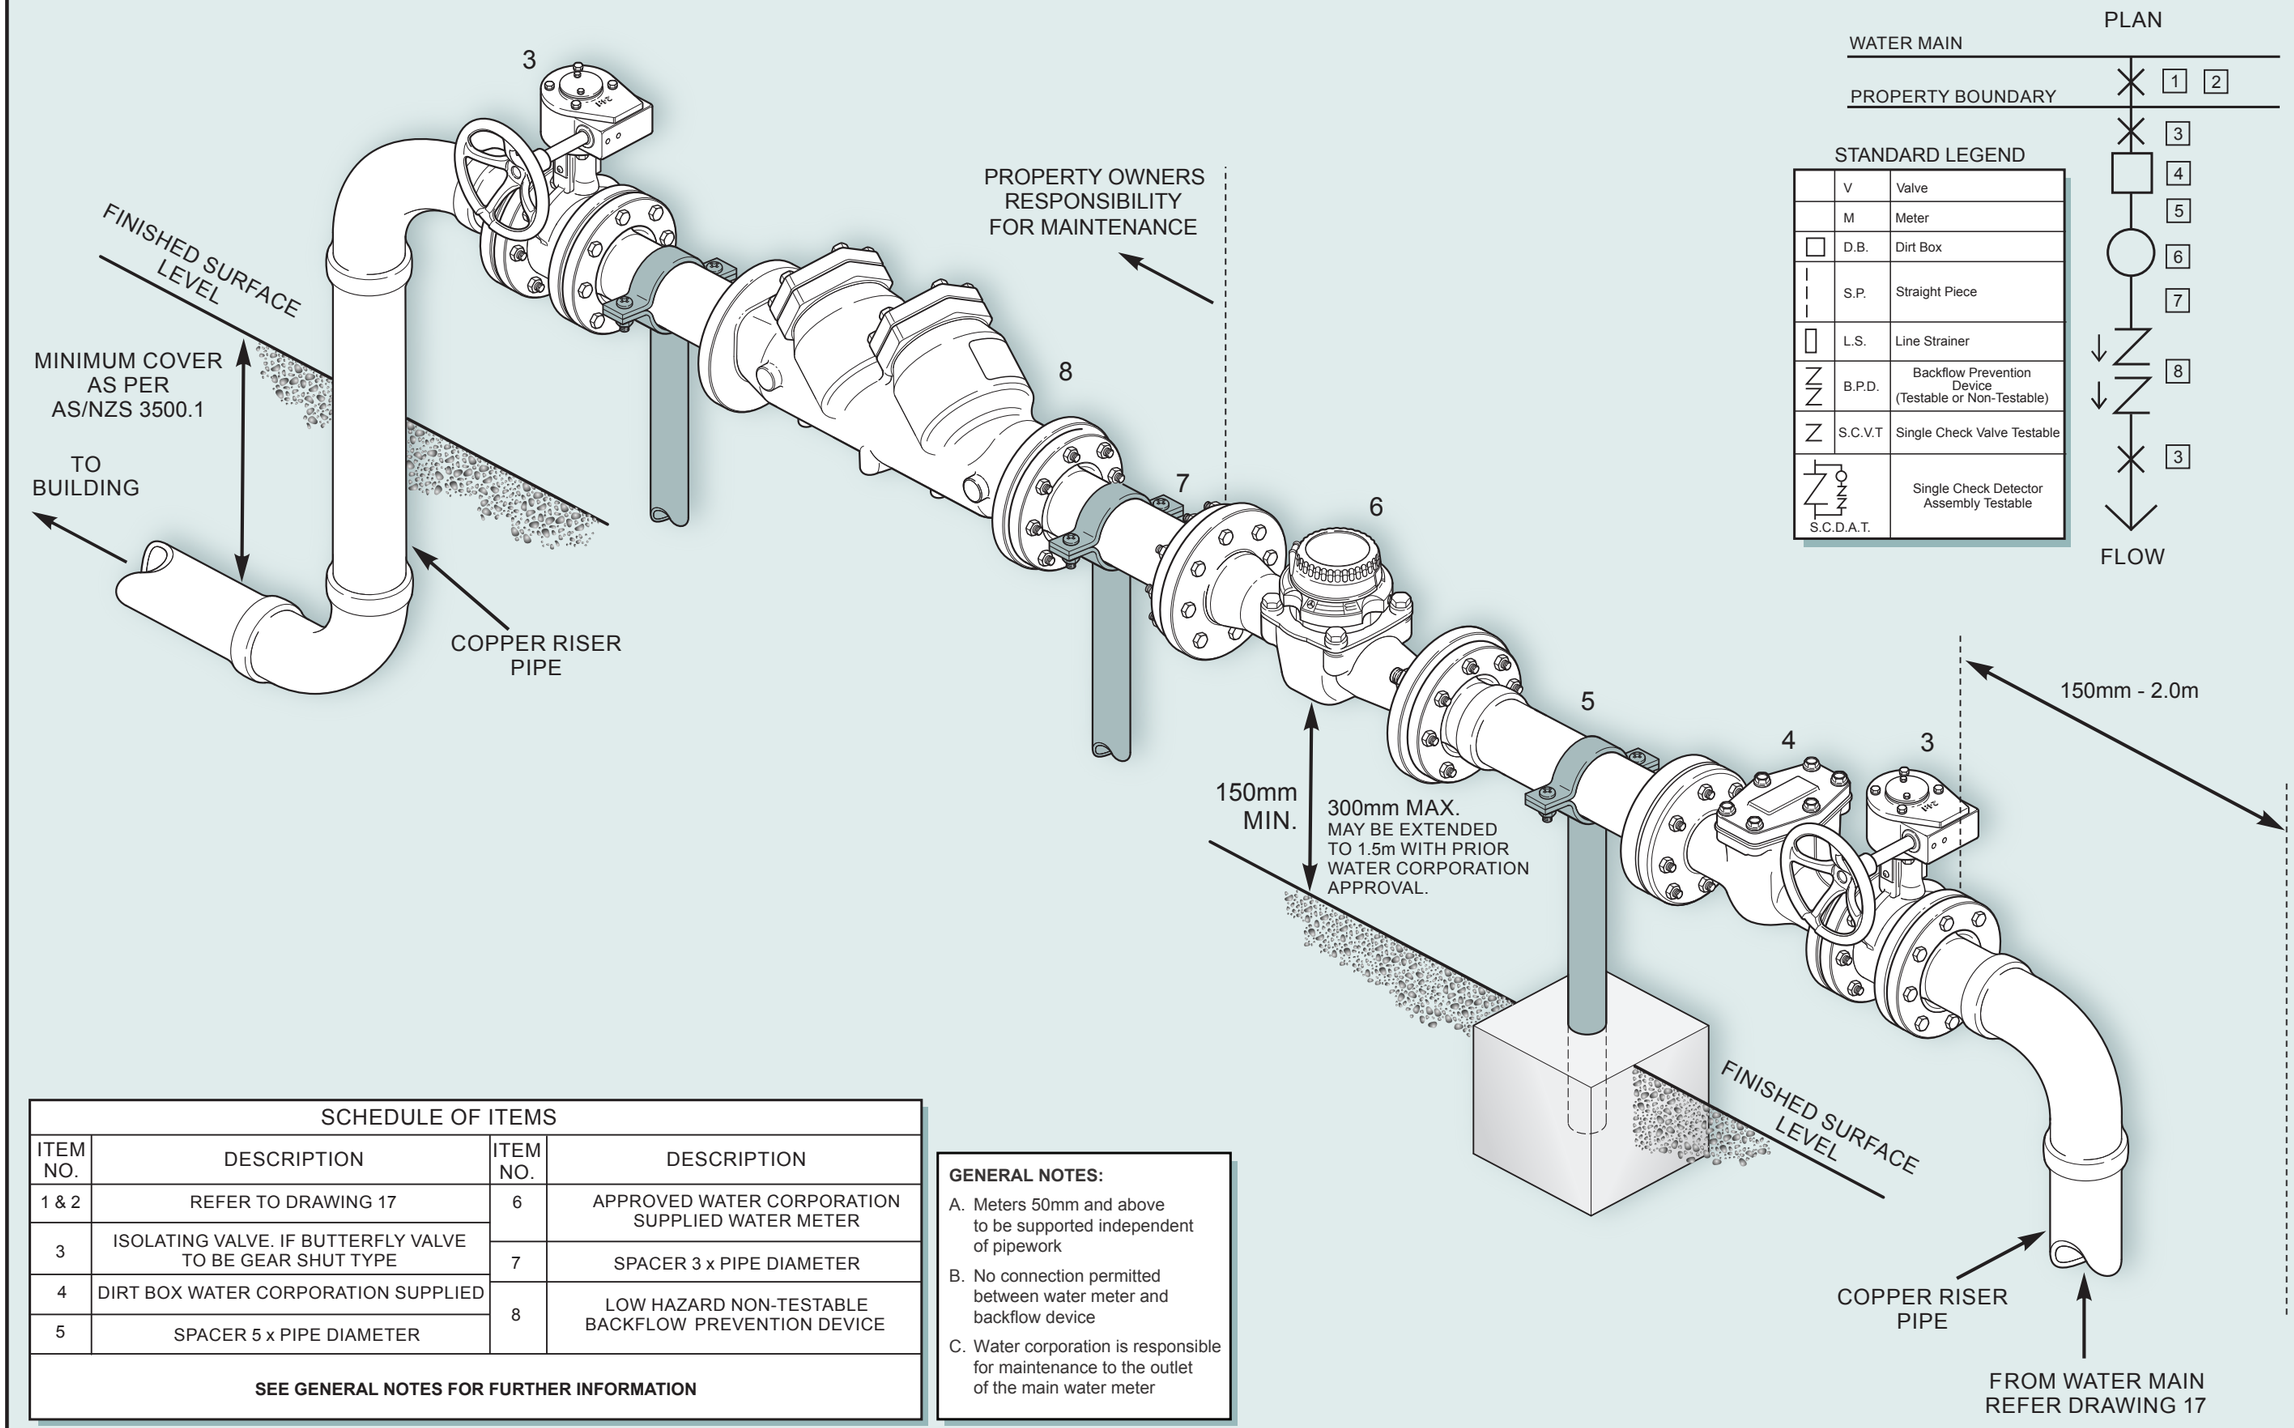

STANDARD LEGEND

	V	Valve
	M	Meter
□	D.B.	Dirt Box
‖	S.P.	Straight Piece
▯	L.S.	Line Strainer
	B.P.D.	Backflow Prevention Device (Testable or Non-Testable)
	S.C.V.T	Single Check Valve Testable
	S.C.D.A.T.	Single Check Detector Assembly Testable

SCHEDULE OF ITEMS

ITEM NO.	DESCRIPTION	ITEM NO.	DESCRIPTION
1 & 2	REFER TO DRAWING 17	6	APPROVED WATER CORPORATION SUPPLIED WATER METER
3	ISOLATING VALVE. IF BUTTERFLY VALVE TO BE GEAR SHUT TYPE	7	SPACER 3 x PIPE DIAMETER
4	DIRT BOX WATER CORPORATION SUPPLIED	8	LOW HAZARD NON-TESTABLE BACKFLOW PREVENTION DEVICE
5	SPACER 5 x PIPE DIAMETER		

SEE GENERAL NOTES FOR FURTHER INFORMATION

GENERAL NOTES:

A. Meters 50mm and above to be supported independent of pipework

B. No connection permitted between water meter and backflow device

C. Water corporation is responsible for maintenance to the outlet of the main water meter

DRAWING NUMBER:	SCALE:	DATE:	
6	NOT TO SCALE	SEPTEMBER 2024	80mm+ GENERAL WATER SERVICE LOW HAZARD RESIDENTIAL / COMMERCIAL / INDUSTRIAL TYPICAL ARRANGEMENT

Greater Western Water | South East Water | Yarra Valley Water