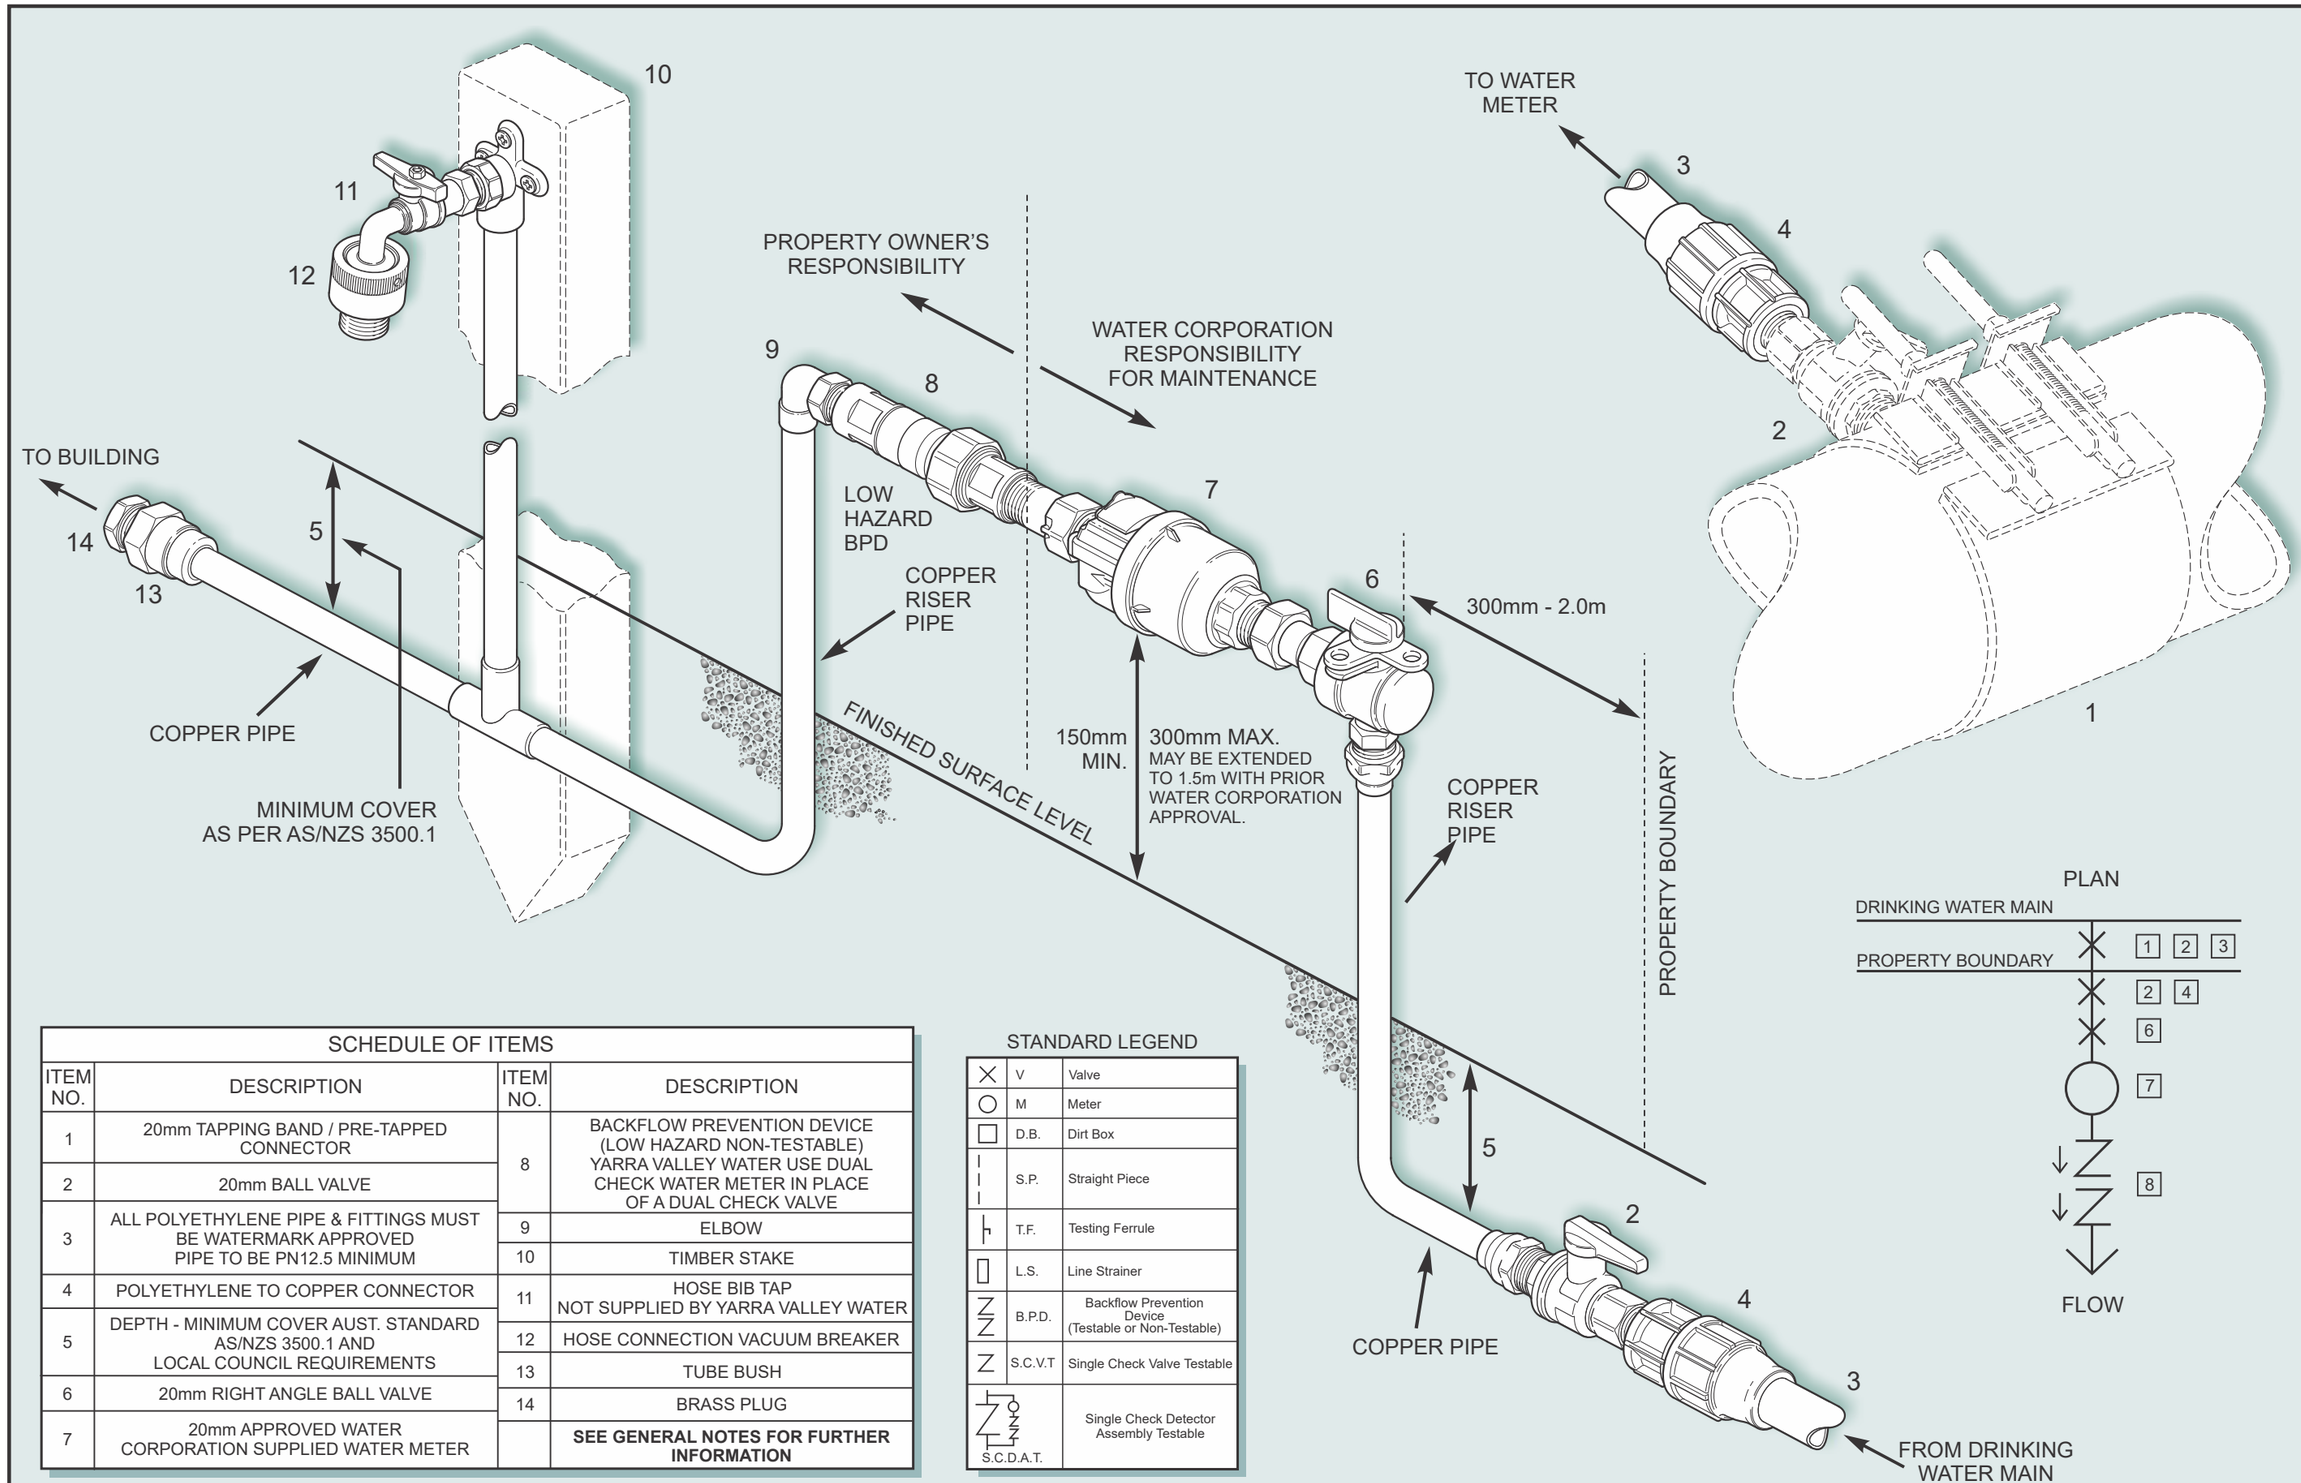

SCHEDULE OF ITEMS			
ITEM NO.	DESCRIPTION	ITEM NO.	DESCRIPTION
1	20mm TAPPING BAND / PRE-TAPPED CONNECTOR	8	BACKFLOW PREVENTION DEVICE (LOW HAZARD NON-TESTABLE) YARRA VALLEY WATER USE DUAL CHECK WATER METER IN PLACE OF A DUAL CHECK VALVE
2	20mm BALL VALVE	9	ELBOW
3	ALL POLYETHYLENE PIPE & FITTINGS MUST BE WATERMARK APPROVED PIPE TO BE PN12.5 MINIMUM	10	TIMBER STAKE
4	POLYETHYLENE TO COPPER CONNECTOR	11	HOSE BIB TAP NOT SUPPLIED BY YARRA VALLEY WATER
5	DEPTH - MINIMUM COVER AUST. STANDARD AS/NZS 3500.1 AND LOCAL COUNCIL REQUIREMENTS	12	HOSE CONNECTION VACUUM BREAKER
6	20mm RIGHT ANGLE BALL VALVE	13	TUBE BUSH
7	20mm APPROVED WATER CORPORATION SUPPLIED WATER METER	14	BRASS PLUG
			SEE GENERAL NOTES FOR FURTHER INFORMATION

STANDARD LEGEND

V	Valve	
M	Meter	
D.B.	Dirt Box	
S.P.	Straight Piece	
T.F.	Testing Ferrule	
L.S.	Line Strainer	
B.P.D.	Backflow Prevention Device (Testable or Non-Testable)	
S.C.V.T	Single Check Valve Testable	
S.C.D.A.T.	Single Check Detector Assembly Testable	

DRAWING NUMBER:	SCALE:	DATE:	
1A	NOT TO SCALE	JULY 2017	20mm DRINKING WATER (DRY TAPPING) LOW HAZARD RESIDENTIAL INSTALLED BY RELEVANT WATER CORPORATION TYPICAL ARRANGEMENT

Greater Western Water | South East Water | Yarra Valley Water