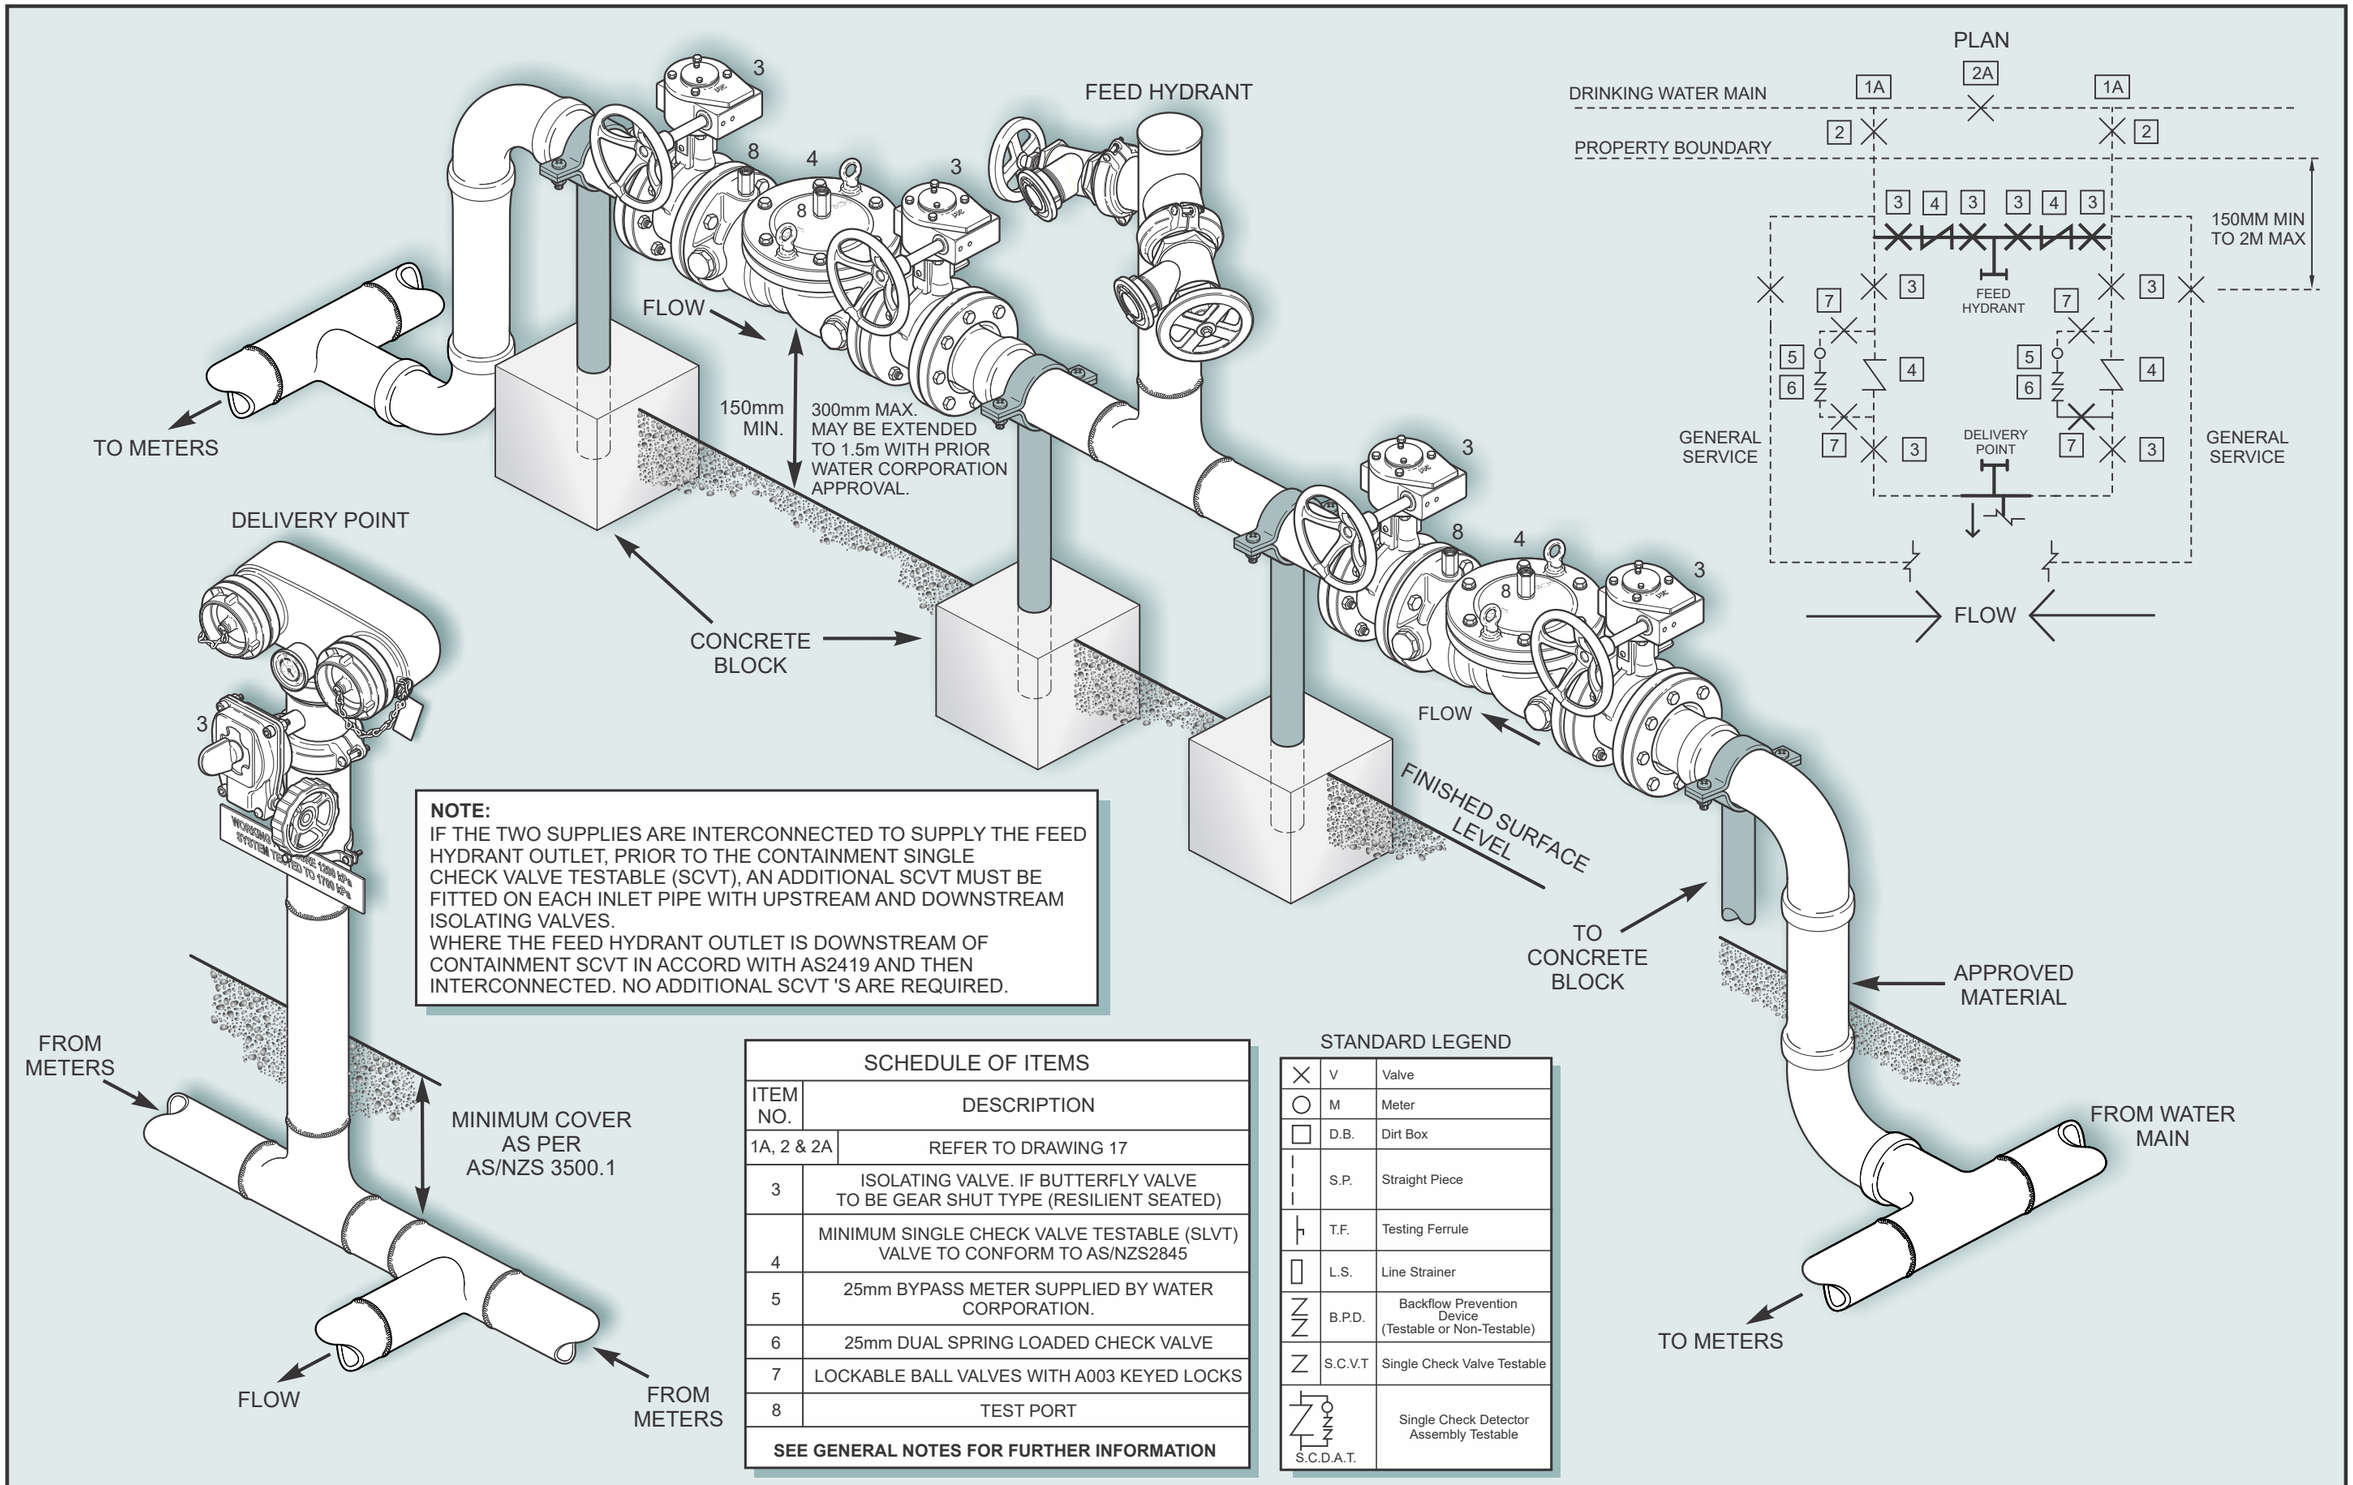

NOTE:
IF THE TWO SUPPLIES ARE INTERCONNECTED TO SUPPLY THE FEED HYDRANT OUTLET, PRIOR TO THE CONTAINMENT SINGLE CHECK VALVE TESTABLE (SCVT), AN ADDITIONAL SCVT MUST BE FITTED ON EACH INLET PIPE WITH UPSTREAM AND DOWNSTREAM ISOLATING VALVES.
WHERE THE FEED HYDRANT OUTLET IS DOWNSTREAM OF CONTAINMENT SCVT IN ACCORD WITH AS2419 AND THEN INTERCONNECTED. NO ADDITIONAL SCVT 'S ARE REQUIRED.

SCHEDULE OF ITEMS

ITEM NO.	DESCRIPTION
1A, 2 & 2A	REFER TO DRAWING 17
3	ISOLATING VALVE. IF BUTTERFLY VALVE TO BE GEAR SHUT TYPE (RESILIENT SEATED)
4	MINIMUM SINGLE CHECK VALVE TESTABLE (SLVT) VALVE TO CONFORM TO AS/NZS2845
5	25mm BYPASS METER SUPPLIED BY WATER CORPORATION.
6	25mm DUAL SPRING LOADED CHECK VALVE
7	LOCKABLE BALL VALVES WITH A003 KEYED LOCKS
8	TEST PORT
SEE GENERAL NOTES FOR FURTHER INFORMATION	

STANDARD LEGEND

	V	Valve
	M	Meter
	D.B.	Dirt Box
	S.P.	Straight Piece
	T.F.	Testing Ferrule
	L.S.	Line Strainer
	B.P.D.	Backflow Prevention Device (Testable or Non-Testable)
	S.C.V.T	Single Check Valve Testable
	S.C.D.A.T.	Single Check Detector Assembly Testable

DRAWING NUMBER:	SCALE:	DATE:	
15A	NOT TO SCALE	JULY 2017	INTERCONNECTION SUPPLY TO FEED HYDRANT - TYPICAL ARRANGEMENT RELATING TO DRAWINGS 15 & 16

Greater Western Water
South East Water
Yarra Valley Water