


FOR THE USE OF INLINE WATER METERS
REFER TO METERING GUIDELINES,
CLAUSE 10.3

NOTE: Yarra Valley Water require a plugged 25mm BSP connection at this location. Greater Western Water and South East Water **do not** allow any connection, outlet or plugged fitting between the water meter and the backflow device

The backflow device is generic only. Check the Notice of Agreement for backflow requirements. The required backflow device must be installed with all necessary valves to comply with AS/NZ3500.1 Section 4

WHERE FIRE SERVICES HAVE HOSE REELS IN AREAS SUBJECT TO POTENTIAL INTERCONNECTION WITH CONTAMINANTS, THE TYPE OF BACKFLOW PREVENTION DEVICE INSTALLED AT THE WATER METER MUST BE RELEVANT TO THE HAZARD RATING OF THE PROPERTY.

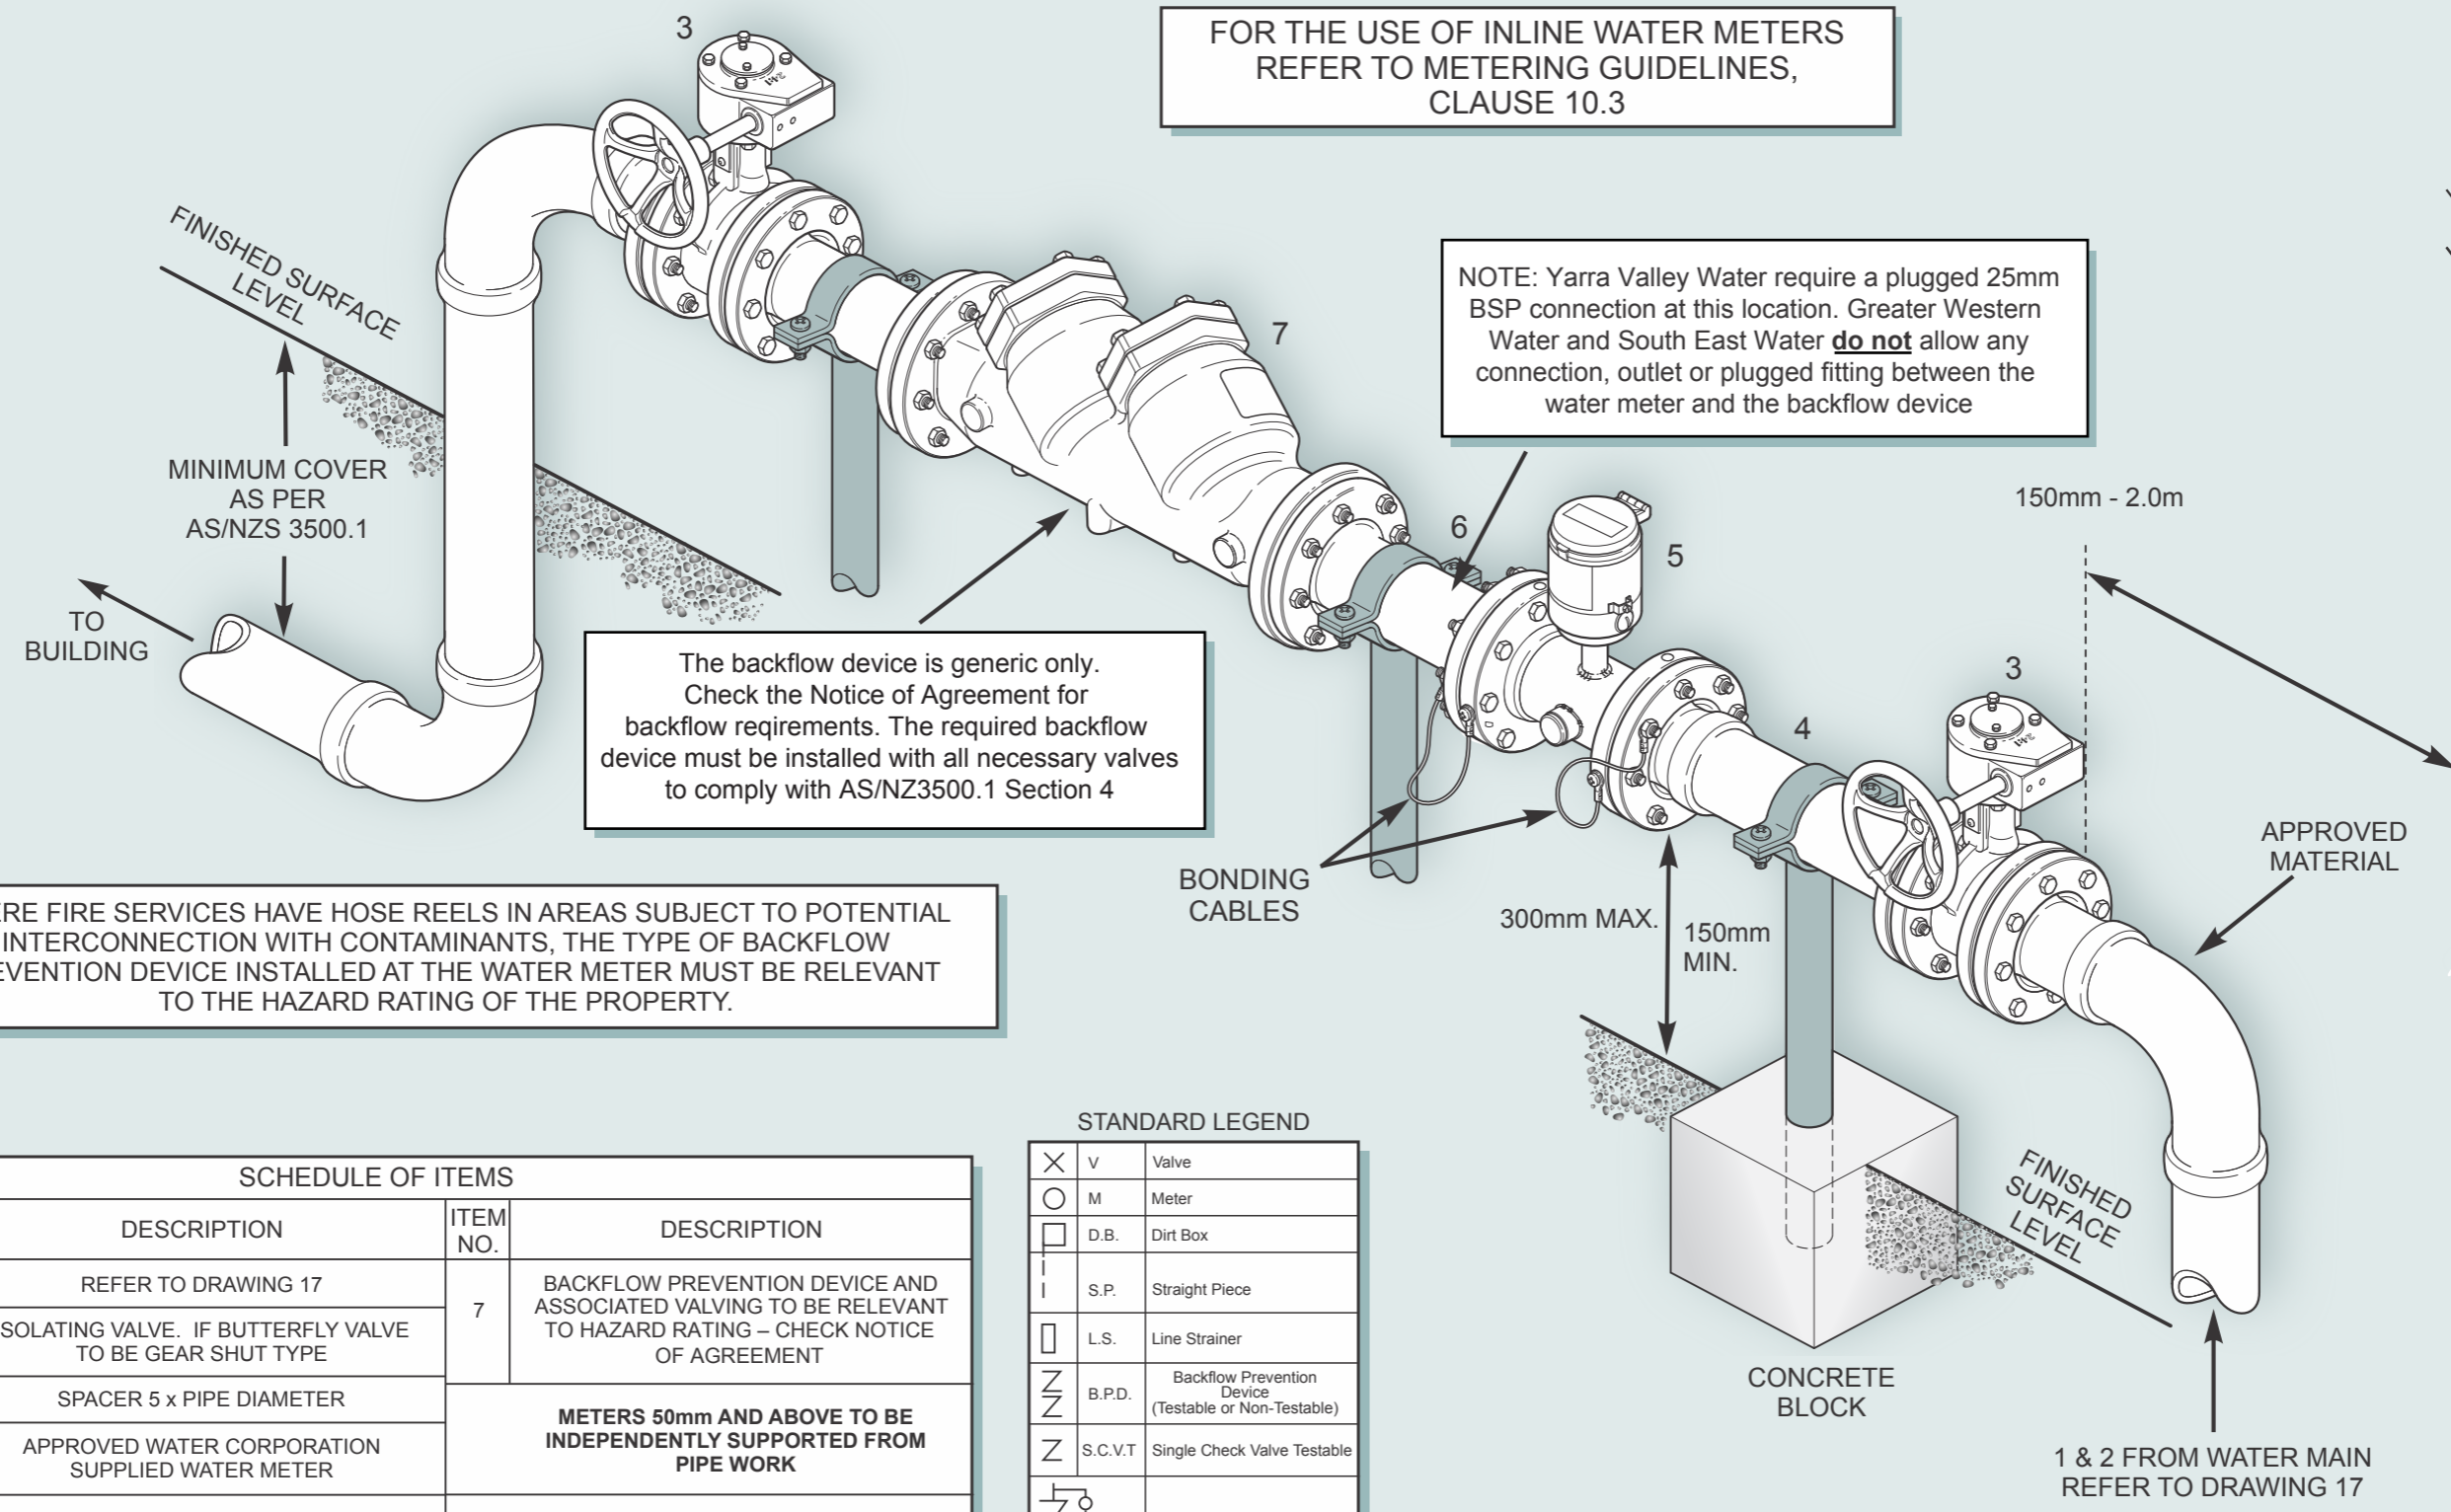

SCHEDULE OF ITEMS			
ITEM NO.	DESCRIPTION	ITEM NO.	DESCRIPTION
1 & 2	REFER TO DRAWING 17	7	BACKFLOW PREVENTION DEVICE AND ASSOCIATED VALVING TO BE RELEVANT TO HAZARD RATING – CHECK NOTICE OF AGREEMENT
3	ISOLATING VALVE. IF BUTTERFLY VALVE TO BE GEAR SHUT TYPE		
4	SPACER 5 x PIPE DIAMETER	METERS 50mm AND ABOVE TO BE INDEPENDENTLY SUPPORTED FROM PIPE WORK	
5	APPROVED WATER CORPORATION SUPPLIED WATER METER		
6	SPACER 3 x PIPE DIAMETER	SEE GENERAL NOTES FOR FURTHER INFORMATION	

STANDARD LEGEND		
⊗	V	Valve
○	M	Meter
□	D.B.	Dirt Box
—	S.P.	Straight Piece
▭	L.S.	Line Strainer
⌌	B.P.D.	Backflow Prevention Device (Testable or Non-Testable)
⌌	S.C.V.T	Single Check Valve Testable
⌌	S.C.D.A.T.	Single Check Detector Assembly Testable